



Village of Phoenix

Initial Lead Service Line Replacement Plan

REL Project 23-R0909

April 15, 2024



Table of Contents

1.0	Overview	1
1.1	Introduction	1
2.0	Background Information	1
2.1	Location	1
2.2	Community Water Supply (CWS).....	1
3.0	Lead Service Line Inventory (LSLI)	1
3.1	Summary.....	1
3.2	Previous Replacements.....	2
4.0	Funding Considerations	2
4.1	Federal & State Funding Sources.....	3
4.1.1	IEPA State Revolving Fund (SRF).....	3
4.1.2	Illinois Department of Commerce and Economic Opportunity (DCEO) Grant.....	3
4.1.3	HUD Community Development Block (CDB) Grant.....	3
4.1.4	Congressional Discretionary Funding.....	4
4.1.5	United States Environmental Protection Agency (USEPA) Community Change Grants.....	4
	defined. Error! Bookmark not defined.	
4.2	Revenue-Generating Funding Sources	4
4.2.1	Increased Local Sales Tax	4
4.2.2	Increase of Other Tax Sources	4
4.3	Potential Funding.....	4
4.4	Financial Plan	4
5.0	Prioritization	5
5.1	Risk Factors.....	5
5.2	Prioritization Factors by Vermont Department of Environmental Conservation	5
5.3	Emergency Work-related Lead Service Line Replacement (EW-LSLR).....	6
6.0	Lead Service Line Replacement (LSLR)	6
6.1	Scope of LSLR.....	6
6.2	Replacement Methods	6
6.3	Completed LSLR.....	8
7.0	Workforce Development	8
8.0	Resident Communication and Outreach	10

Appendices

Appendix 1..... Code of Ordinances

Appendix 2.....Complete Lead Service Line Inventory

Appendix 3.....Building Age Map

Appendix 4.....Water Rates

Appendix 5..... LSLR Details

Appendix 6.....Lead Service Line Replacement Outreach Materials

Phoenix

1.0 Overview

1.1 Introduction

The Lead Service Line Replacement and Notification Act (Act), State of Illinois Public Act 102-0613, went into effect on January 1, 2022. This Act required that every owner or operator of a community water supply (CWS) that has known or suspected lead service lines (LSLs) create a plan to replace each lead and galvanized service line (if connected downstream of lead piping); submit that initial plan to the Illinois Environmental Protection Agency (Agency) by April 15th, 2024; submit by April 15th of each year after 2024 until 2027 an updated lead service line replacement plan to the Agency; and submit by April 15th, 2027 a final lead service line replacement plan to the Agency. The Act also requires that the plan is posted on the community water supply's website.

The Act also requires that the plan is posted on the community water supply's website. This Plan will be available on the Village's website until April 15, 2025, at which time it will be replaced with an updated Plan.

The Village of Phoenix has prepared an initial Lead Service Line Replacement Plan (Plan) in compliance with the Act and its requirements. The Plan includes the name and identification number of the CWS; an inventory of the total service lines, known and suspected LSLs, and LSLs that have been replaced since 2020; a proposed replacement schedule; a cost analysis with financing options; a prioritization plan; community outreach measures; and workforce development measures.

2.0 Background Information

2.1 Location

The Village of Phoenix is located in Cook County in northeastern Illinois approximately 23 miles south of downtown Chicago in Cook County, IL. The Village is bounded by Harvey to the west and South Holland to the east. The Village corporate boundaries encompass an area of approximately 0.46 square miles.

2.2 Community Water Supply (CWS)

The Community Water Supply (CWS) is named Phoenix and is IEPA Water System No. IL0312490. The CWS serves a population of 1,994 and has 637 service connections as reported to the IEPA and posted to Illinois.gov under the Illinois Drinking Water Watch.

The CWS takes ownership of the service line extending from the water main to the water shut-off valve or Buffalo Box (b-box)/curb stop while the property owner takes ownership of the service line from the water shut-off valve or Buffalo Box (b-box)/curb stop according to the Village's Code of Ordinances, listed in Appendix 1.

3.0 Lead Service Line Inventory (LSLI)

3.1 Summary

The definitions of water service line materials in the CWS's inventory adheres to the definitions provided by the Illinois EPA. These definitions are outlined in the table below.

Service Line Material
Copper – No Lead Solder (C)
Galvanized Requiring Replacement (GRR)
Lead (L)
Cast/Ductile Iron (O)
Unknown (U)
Unknown Not Lead (UNL)

The CWS has made ongoing efforts to complete its inventory. These efforts include those listed below: reviewing resident surveys, water meter replacement records, a property’s building age, exploratory excavations at targeted locations, and visual inspection of interior service lines.

- **Building Age:** For those buildings constructed after 1988, service lines are assumed to be non-lead on both the public and private sides.
- **Historical Records:** Where available, historical records were used to identify service line material. Historical records could include water meter replacement records, water main replacement records, water main tapping cards, water meter cards, permit records, and documentation from maintenance and repairs.
- **Visual Identification:** The CWS staff recorded service line material when entering private property.
- **Resident-Provided Photos:** The CWS distributed a survey in which residents could provide photos of their service line. A sample survey mailer is included in Appendix 6. Trained staff identify the service line material based on the photos and the photo and material are recorded and saved on the CWS GIS.
- **Exploratory Excavations:** Very few records contain information on the public-side service line material. A contractor excavated in the parkway to determine public-side material at select locations to determine lead density throughout the service area.

The current inventory includes:

- The total number of services lines in the CWS for the current year;
- The material composition of each service line in the CWS’s distribution system;
- The count of suspected lead service lines identified since the last inventory submission;
- The number of suspected or known lead service lines replaced since the last inventory submission

A copy of the inventory submitted to the Agency that lists the total number of service line connections, total LSLs, and total suspected LSLs is included in Appendix 2. A map of the building ages in the CWS is included in Appendix 3. Buildings built prior to 1970 have a higher probability of having a lead service.

Service Material	# of Services	
	Private	Public
Lead (L)	310	0
Unknown (U)	17	664
Galvanized Requiring Replacement (GRR)	56	0
Not Lead	281	0

3.2 Previous Replacements

The CWS has not begun replacing lead and galvanized service lines.

4.0 Funding Considerations

The funding sources for the Lead Service Line Replacement (LSLR) Program will be considered and evaluated in this section. A proposed funding plan to meet the requirement to complete the LSLR within the fifteen (15) year replacement timeframe will be presented.

Based on an inventory of 366 LSLs and a replacement cost of \$11,000, the CWS will need \$4,026,000 to fund the LSLR Program. The CWS will likely use a combination of the funding sources described in this section. With a mandated replacement rate of 7%, the CWS will plan to replace 26 LSLs annually at a projected cost of \$286,000.

4.1 Federal & State Funding Sources

Other possible funding sources would be periodically evaluated for favorability and affordability. These funding sources could include:

Illinois Environmental Protection Agency (IEPA) State Revolving Fund Loan Program (SRF)

Illinois Department of Commerce and Economic Opportunity (DCEO) Grants

HUD-administered Community Development Block Grant (CDBG)

Congressional Discretionary Funding

United States Environmental Protection Agency (USEPA) Community Change Grants

LeadCare Cook County

Rebuild Illinois Program

4.1.1 IEPA State Revolving Fund (SRF)

The Bipartisan Infrastructure Act reserved \$15 billion in funding for LSLR in the United States over five years. To date, the State of Illinois has received \$337.1 million in the first two years of funding. The amount of funding reserved for LSLR in the State of Illinois for the next three years is unknown. This funding is available as low-interest and forgivable loans allocated through the Illinois EPA SRF loan program.

The IEPA SRF loan program awards loans according to census tract scoring that considers demographic information that will be discussed in more detail in the Prioritization section. A preliminary census tract ranking system was developed with available census data and 2023 inventory information. The ranking may change with updates to the census demographic data or with any changes in the number and density of lead services. This ranking system is developed using the best available knowledge and will be updated annually with new information.

For planning purposes, the CWS will assume that it receives forgivable loans for LSLR in census tracts with a combined score higher than 300 and 0% interest loans for LSLR in census tracts with a combined score higher than 250.

Forgivable Loan Census Tract	Score	Rank	LSLs
Census Tract 8272, Cook County, Illinois	305	507	366

Current estimates suggest that the SRF loan program could provide forgivable loans for 366 LSLRs within the CWS, which accounts for 100% of the CWS's LSLRs. The funding related to these replacements is estimated to be approximately \$4,026,000.

4.1.2 Illinois Department of Commerce and Economic Opportunity (DCEO) Grant

The Office of Community Development supports economic development, community development, and infrastructure improvements in Illinois communities with substantial low-to-moderate-income populations. Various DCEO grants can be used for LSLR funding. The CWS will periodically review available grants.

4.1.3 HUD Community Development Block (CDB) Grant

The Office administers the federally funded Community Development Block Grant (CDBG) program that assists low-income populations. LSLR Programs are eligible for CDBG funding in qualifying areas. The CWS will evaluate their eligibility for CDBG funding.

4.1.4 Congressional Discretionary Funding

Each member of the United States Congress receives an allotment of grant funding to be used at their discretion annually. While no funding has been awarded and it is unlikely that Congressional Discretionary Funding will be a significant source of funding, this source of funding is still an option to fund a portion of a project.

4.2 Revenue-Generating Funding Sources

The local and direct revenue generating methods that are evaluated in the Plan are:

- Increased local sales taxes
- Resident cost sharing
- Water rate increase
- Increase of other taxes

The Village has expressed that they are not currently considering implementing any water rate increases, tax increases, or subsidization of private side service line replacement to pay for replacements. These options are included only as a potential future funding source.

4.2.1 Increased Local Sales Tax

Communities, counties, and sports authorities have imposed a modest sales tax increase over a determined period of time to generate revenue from the constituents that benefit from the proposed improvement.

The Village of Phoenix municipal Sales Tax generated \$322,645 in FY22. The sales tax rate for retail sales in Phoenix is:

Illinois	6.25%
Cook County	1.75%
Phoenix	1.00%
Regional Transportation Authority	1.00%
	10.00%

Therefore, if the Phoenix Municipal Sales Tax were increased 0.25%, an additional \$80,600 ($0.25/1 \times \$322,645$) would be available annually for LSLR. If the tax were increased 0.50% then \$161,300 could be available annually for LSLR. An increase in local sales tax could fund 7 or 14 LSLRs annually, respectively.

4.2.2 Increase of Other Tax Sources

Besides sales and property taxes, the State of Illinois has about twenty-six other revenue sources as taxes, fees, assessments, license fees, lottery, use fees, transfer tax and user fees ranging from Automobile Renting Occupation and Use Tax to Video Gaming Tax and License Fee. The time to enact a tax in any form to fund the LSLR is prohibitive and the likelihood of enactment is very low, based on existing taxes. Additional revenue from State funding or from Federal sources into a State administered fund is not guaranteed.

4.3 Potential Funding

The CWS could use a combination of any of the methods discussed above to generate sufficient funds to cover the replacement costs. However, it is the intent of the CWS to maximize grants and forgivable loan awards to cover LSLR costs.

4.4 Financial Plan

The CWS will consider all funding sources listed above. The financial plan, like the other elements of the Plan, is a living document and can change as the availability of funding changes. Currently, the CWS plans to take advantage of the SRF loan program to fund the replacements. The CWS will continue to develop a financial plan for future replacements as more information on the inventory, bidding environment, and funding is gathered.

5.0 Prioritization

Since the number of LSLs in the system exceeds the number of replacements the CWS can afford in a single year, the LSLR Program must include an element of prioritization. The CWS will follow the mandated replacement rate of 7% or 26 LSLs per year for 15 years laid out in the Act. The CWS will prioritize replacement project areas based on risk factors and planned companion infrastructure projects.

5.1 Risk Factors

The population most at risk of exposure to lead and with the highest health risks when exposed is children and seniors in disadvantaged areas. The IEPA SRF loan program incorporates census data for median household income, children under the age of 6, unemployment rate, poverty rate, social security rate, and supplemental security income to prioritize at-risk populations. The CWS will use the IEPA SRF scoring system to prioritize those areas with the most at-risk populations.

The CWS will also prioritize replacements in high-risk facilities such as daycares, schools, parks, hospitals, and nursing homes.

5.2 Prioritization Factors by Vermont Department of Environmental Conservation

When the service area of the CWS with the same level of risk contains more lead services than can be replaced in a year, the CWS will consider companion infrastructure projects such as water main replacements, water meter replacements, and road resurfacing projects when prioritizing each year's project area.

The Vermont Department of Environmental Conservation developed a prioritization rubric as a standard and transparent method for determining replacement order according to the factors discussed. The table below lists the prioritization factors and priority points as recommended by the Vermont Department of Environmental Conservation and then the priority points developed by the CWS to account for the Illinois-specific requirements of the Act and IEPA SRF-funding.

As each LSL is identified and categorized with any possible number of the prioritization factors listed below, the summation of the factors yields a prioritization points Score using the rubric, as a guide to scoring based on the criteria, as shown below

Priority Points – Vermont Department of Environmental Conservation	CWS /REL Priority Points	Prioritization Factor	LCRR Requirement
10	8	Known Lead Service Line	Required
10	80	Populations Most Sensitive to the Effects of Lead • Schools and Day Care Facilities • Homes with children and/or adults who are pregnant or may become pregnant	Required
10	10	Disadvantaged Communities	Required
8	8	Known GRR Service Line	Required
5	2	Populations Most Sensitive to the Effects of Lead • Nursing Homes • Medical Facilities	Not Required
5	8	Companion Projects (concurrent infrastructure projects)	Not Required

5	8	Compact Projects (concurrent project in the same area)	Not Required
3	8	Long Length Lead Pipe Projects (or high lead results)	Not Required
2	6	Other Factors Listed in ANSI/AWWA C810-17 § II.A. <ul style="list-style-type: none"> • Service lines physically disturbed by digging, excavation, repair, or other activities • Existing partial lead service line replacements • Consideration of presence of lead goosenecks or pigtails 	Not Required
N/A	20	Funding Eligibility	Not Required
N/A	5	LSL Density	Not Required
1	5	Other Factors Significant to the Water System	Not Required

5.3 Emergency Work-related Lead Service Line Replacement (EW-LSLR)

LSLR instances arising from breaks or leaks on the public side of the service line are completed under this program. Upon notification of a break or leak from the customer, the Water Department dispatches a crew to assess the location and feasibility of repair. Subsequently, an EW-LSLR is initiated to replace the affected lead service. Private-side breaks or leaks are not covered under this program.

6.0 Lead Service Line Replacement (LSLR)

6.1 Scope of LSLR

The work shall consist of the removal and replacement of lead or galvanized iron water services for buildings within the specified service area. The area will be determined based on prioritization, material, building age, and funding limits, but all will be within the corporate boundaries of the CWS. New copper service lines shall be installed for full and partial lead service line replacement. Full lead service line replacement shall be defined as connecting from the water main to inside the building. Partial service line replacement shall be defined as connecting from the curb box (B-box or buffalo box) to the water main. No lead piping will be left in the water system. Partial replacements will only occur where the existing service is partially lead or galvanized. Cross-sectional replacement details are included in Appendix 5.

Replacements will begin in Census Tract 8272. These replacements are expected to last fifteen years at the mandated replacement rate but will depend on the maximum amount of annual IEPA SRF funding received.

6.2 Replacement Methods

The methods of installing the new service are described below. To minimize impacts to residential property and to reduce restoration, trenchless methods are preferred.

Open cut: Open cut trenching is the typical method used by plumbers, especially for properties slated for demolition and replacement. It involves digging a trench, which can cause significant exterior disruption to property owners. Interior disturbances depend on whether the basement is finished. Despite its disturbance, open cut trenching is often the most cost-effective option, particularly when restoration costs are minimal. This approach is advised based on individual circumstances.

Trenchless: Trenchless installation of water services is being explored to address concerns such as economic impact, landscape disruption, and social inconveniences associated with traditional open cut methods. Advances in trenchless

technologies offer a more efficient alternative in certain situations, minimizing surface disruption and restoration time. These methods are socially appealing as they cause less destruction and require less restoration compared to open cut techniques.

Standard Horizontal Directional Drilling: Standard Horizontal Directional Drilling (HDD) involves using a drill rig on the ground surface to create a tunnel underground. To reach a depth of about 5'6" below the ground surface, the drill rig head must be positioned approximately 30 feet away from the final depth point of the water service. This may require closing the road for safety. While many pipeline and cable contractors employ this method, plumbing contractors often subcontract it out as specialty work.

Pipe pulling: Pipe pulling is the most cost-effective method among trenchless options for installing water services. It involves using the path of the existing pipe, eliminating the need for additional excavation. A new water service pipe is pulled along the existing route, often with a winch or excavator bucket with a cable. The new copper service is connected to the existing lead service in the home, effectively replacing it using the borehole left by the removed lead pipe.

The connection to the water main typically incorporates the use of a tapping sleeve and is done by a licensed plumber. The licensed plumber also connects the new service line to the existing water meter inside the house according to the State of Illinois plumbing code.

Prior to completion of the work, the Contractor shall provide each address that received a new service line with a Point of Use water filter that meets both NSF/ANSI 42 and 53 certifications for lead reduction with a minimum capacity of 0.5 gallons and six months of replacement cartridges or a minimum of 150 gallons of filtration capacity. The filter shall not be a permanent faucet filter. The Contractor shall have the resident provide a signature to acknowledge receipt of the filter on a form provided by the Village. The form shall be turned in with other documentation.

Prior to beginning the work of connecting the new service inside the house, the water supply to the service line and the property owner shall be shut off to avoid release of particulate lead into the property owner's premises. After all connections have been completed, the Contractor shall flush the water from an outside connection (such as a hose bibb or hose leading from the building side of the meter) to remove any particles in the service line. Flush at full velocity for at least 30 minutes. The Contractor shall then advise the property owner to flush the interior premise plumbing in accordance with the instructions provided in the Owner-provided informational material. This work shall be conducted in accordance with AWWA C810-17 – Replacement and Flushing of Lead Service Lines.

The Village will use these standards when performing lead service line replacement:

Item	Condition
1. Restoration of Interior and Exterior	Meet existing condition or better
2. Parkway/Yard Restoration	Sod, Seed in Summer
3. Field Locate B-boxes	Location by Village
4. Trench backfill	CA-6
5. Verify B-box operation at Project Completion – after surface restoration	B-boxes keyed by Village
6. Street Cross Sections	Minimum 6-inch pavement patching
7. Work Hours	Monday to Friday 7 am to 7 pm Saturday 8 am to 7 pm No Work Sunday or Holidays, except Contractor my Schedule meeting/inspection at buildings on Sunday.
8. Meter Pits	Village will be consulted prior to relocating meter to building interior and abandoning

	the meter pit. Contingency Pay Item for this work included in contract.
9. B-box	Mueller H-10302, Minneapolis Pattern or approved equal
10. Curb stop	Mueller Ball Style: H15150 or approved equal
11. Corp Stop	Mueller H-15000 or approve equal
12. Saddle for corp stop	Cascade CSC-2 or approved equal
13. Abandon existing Lead Service Line	Close corp stop; remove lead service from main; remove corp and reuse direct tap by placing tapping sleeve and peen end of lead service. Use abandoned corporation fitting for winter time.

6.3 Completed LSLR

The CWS has not completed any lead service line replacement projects.

7.0 Workforce Development

In performing projects associated with the Lead Service Line Replacement initiative, the CWS plans to develop the workforce available to perform these projects. These developmental practices include:

Smaller bids: The CWS will break the required replacements into smaller projects within the CWS, so that the bids will be smaller and more attainable for smaller firms.

College engagement: The CWS will engage with local colleges and institutions to train new individuals entering the workforce.

Hiring local: The CWS will include a clause within the scope of work for interior work and inspections to be conducted by local contractors who have an understanding of the community.

Experience contractor teaching: An experienced contractor teaches a smaller contractor how to perform the work.

Diversity in hiring practices are another aspect to workforce development and would include contacting all local MBE and WBE contractor associations during bidding.

The Contractor shall also take the following specific affirmative action to ensure equal employment opportunity:

- Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites, and in all facilities at which the Contractor's employees are assigned to work. The Contractor, where possible, will assign two or more women to each construction project. The Contractor shall specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.
- Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions have employment opportunities available, and maintain a record of the organizations' responses.
- Maintain a current file of the names, addresses and telephone numbers of each minority and female off-the-street applicant and minority or female referral from a union, a recruitment source or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this shall be

documented in the file with the reason; therefore, along with whatever additional actions the Contractor may have taken.

- Provide immediate written notification to the Director when the union or unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or woman sent by the Contractor, or when the Contractor has other information that the union referral process has impeded the Contractor's efforts to meet its obligations.
- Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the Department of Labor.
- Disseminate the Contractor's EEO policy by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO policy on bulletin boards accessible to all employees at each location where construction work is performed.
- Review, at least annually, the company's EEO policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination, or other employment decisions including specific review of these items with onsite supervisory personnel such as Superintendents, General Foremen, etc., prior to the initiation of construction work at any job site. A written record shall be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.
- Disseminate the Contractor's EEO policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the Contractor's EEO policy with other Contractors and Subcontractors with whom the Contractor does or anticipates doing business.
- Direct its recruitment efforts, both oral and written, to minority, female and community organizations, to schools with minority and female students and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month prior to the date for the acceptance of applications for apprenticeship or other training by any recruitment source, the Contractor shall send written notification to organizations such as the above, describing the openings, screening procedures, and tests to be used in the selection process.
- Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer and vacation employment to minority and female youth both on the site and in other areas of a contractor's work force.
- Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.
- Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare for, through appropriate training, etc., such opportunities.
- Ensure that seniority practices, job classifications, work assignments and other personnel practices, do not have a discriminatory effect by continually monitoring all personnel and employment related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.
- Ensure that all facilities and company activities are non-segregated except that separate or single-user toilet and necessary changing facilities shall be provided to assure privacy between the sexes.
- Document and maintain a record of all solicitations of offers for subcontracts from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.
- Conduct a review, at least annually, of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.

8.0 Resident Communication and Outreach

To ensure effective community engagement, the CWS's outreach program for the Lead Service Line Replacement (LSLR) initiative will employ various communication methods aimed at informing and involving homeowners. Central to the program's success is consistent and informative communication across multiple platforms, including meetings, press releases, door-to-door notifications, and social media channels. By leveraging these diverse communication channels, the program aims to raise widespread awareness about the significance of the LSLR program and the options available for homeowners to participate. Early successes of the program will be shared with the community to foster positive feedback and encourage support for the initiative.

To effectively communicate the goals and requirements of the LSLR program, a comprehensive outreach & communication plan is developed, outlining key messaging, target audiences, and preferred communication methods. Emphasis will be placed on building trust and transparency with homeowners, ensuring they understand the benefits of participating in the program. Notices will be sent to homeowners at least 45 days before the commencement of work, with repeated notifications every two weeks until confirmation of receipt. Special attention will be given to non-English speakers, providing translated notices and instructions for accessing additional resources. As previously mentioned, the Community Outreach and Public Engagement plan will be vast, consistent, and includes:

Stakeholder Identification: The CWS has identified key stakeholders, including residents, local businesses, community organizations, schools, healthcare providers, and governmental agencies.

Educational Materials: The CWS is developing comprehensive educational materials explaining the importance of lead service line replacement, potential health risks associated with lead exposure, details of the replacement process, and available resources for assistance. The materials currently developed and used for LSLR outreach are added in Appendix 6.

Multi-Channel Communication: The CWS plans to utilize a variety of communication channels to reach different segments of the community, including:

- Printed materials such as program brochures, flyers, door hangers and direct mail distributed to households, businesses, and public spaces.

- Digital platforms including the village website, email newsletters, and community forums.

- Information sessions and workshops held at community centers, schools, and other public venues.

- Door-to-door outreach by trained community volunteers or outreach workers to engage directly with residents.

Social Media Channels: The CWS intends to utilize its social media platforms to engage with residents regarding lead exposure concerns. Posts will include links to informative resources on the CWS's website, as well as videos and webinars explaining lead risks and the CWS's efforts to mitigate them. Social media will also be used to announce upcoming project activities, public outreach events, and success metrics such as the percentage of lead pipes replaced.

Language and Accessibility: The CWS will ensure that all materials and communication efforts are available in multiple languages to accommodate the linguistic diversity of the community. Additionally, make information accessible to individuals with disabilities by providing alternative formats such as large print or audio versions.

Personalized Outreach: The CWS will tailor outreach efforts to specific demographics or neighborhoods within the service area, taking into account factors such as income level, age, cultural background, and housing status. Engage community leaders and influencers to help disseminate information and encourage participation.

Community Workshops and Events: The CWS has plans to organize community workshops, town hall meetings, and informational events where residents can learn more about the lead service line replacement program, ask questions, and provide feedback. Offer opportunities for hands-on demonstrations or tours of the replacement process and an avenue for public comment on the LSLR plans.

One-on-One Assistance: The CWS intends to provide personalized assistance and support to residents who may have questions or concerns about the replacement program. Establish a dedicated hotline or helpline staffed by knowledgeable personnel to address inquiries and provide guidance.

Feedback Mechanisms: The CWS plans to implement feedback mechanisms such as surveys, focus groups, or public hearings to gather input from residents throughout the planning and implementation phases of the program. Use this feedback to adjust and improvements as needed.

Collaboration and Partnerships: The CWS plans to collaborate with local organizations, community groups, schools, healthcare providers, and government agencies to amplify outreach efforts and leverage existing networks and resources.

Ongoing Engagement: The CWS will maintain ongoing communication and engagement with the community beyond the initial outreach phase. Provide regular updates on the progress of the replacement program, share success stories, and continue to address any concerns or issues that arise.

Non-Participation/Waivers: Homeowners in the CWS may not always be ready to engage with or communicate regarding the LSLR program. At present, the CWS lacks the authority to mandate homeowner access to private property or demand access for replacing the private side of the LSL. For those who choose not to participate, an Illinois Department of Public Health waiver form will be available. Efforts to communicate will be recorded for unresponsive homeowners.

Appendix 1

Code of Ordinances

DIVISION 3. - WATER CONNECTIONS

Sec. 94-60. - Connection to standard water main required.

In all cases where a standard water main is now installed or hereafter may be installed in any street, alley, public way or easement in the village, all water users located on any lot or parcel of real estate fronting or abutting on any such street, alley, public way or easement, shall make or cause to be made connection to such standard water main and pay the tapping charges therefor within three months hereafter or within three months after the installation of such standard water main if the same be not now installed, and all users shall discontinue, within the same period of time, any connection which they theretofore may have had with any other water line.

(Code 1971, § 50.105; Ord. of 7-26-1954)

Sec. 94-61. - Fees.

The fees to be charged for permits to tap or otherwise make a connection with any water main shall be determined in such manners and amounts as shall be prescribed by ordinance adopted by the president and board of trustees from time to time.

(Code 1971, § 50.090; Ord. of 7-26-1954)

Sec. 94-62. - Tapping water mains.

- (a) *Tap to be done by village personnel.* Whenever any permit for a connection with the water mains of the village is issued hereunder, only the superintendent or employee of the village so designated for the work by the superintendent shall tap the main of the system where such connection is to be made and shall insert the corporation stop.
- (b) *Materials provided by village.* All corporation stops, goosenecks, curbstops, buffalo boxes and meter boxes installed in connection with the waterworks system of the village must be purchased through the village.
- (c) *Right of entry.* No person shall in any manner obstruct or cause to be obstructed the free access of any duly authorized officer or employee of the village to any curbstop, water meter, shutoff box or connection with any water main by means of any coal, lumber, brick, building material or by any other means or device whatsoever or to use or to prevent free access thereto by such officer or employee.

(Code 1971, § 50.095; Ord. of 7-26-1954)

Sec. 94-63. - Installation of water service pipes.

- (a) *Pipe laying.* The connection from the main to the curbstop shall be placed at least five feet below the level of the ground and the service pipe shall be laid sufficiently waving so that it shall be at least one foot longer than if laid in a straight line and shall be placed in such a manner as to prevent rupture or breakage from the settling of the ground.
- (b) *Size of connective piping.* All service pipes shall be of type K copper tubing and shall be of not less than three-quarters-inch nominal diameter. No connection with any water main of the village shall be less than three-quarters inch. Each water service pipe shall be connected with the water main and shall extend horizontally at right angles with the water main to a point at least 20 feet from the centerline of the street and shall there be provided with a bronze curbstop of not less than three-quarters inch in diameter to be installed within a telescopic shutoff box of the best quality of cast iron or first grade steel pipe.
- (c) *Angle; T-handle.* The water main must be tapped at an angle of 45 degree with the vertical, and the corporation stop must be turned so that the T-handle will be on top.

(Code 1971, § 50.100; Ord. of 7-26-1954)

Sec. 94-64. - Separate curbstops required.

No service pipe shall be laid or used to supply water to two or more distinct premises or buildings unless separate curbstop for each of the premises or buildings shall be placed outside of such premises in the parkway as provided in section 94-66 and a permit fee shall be obtained for each service.

(Code 1971, § 50.050; Ord. of 7-26-1954)

Sec. 94-65. - Inspection and approval of service pipes.

All service pipes and connections shall be inspected and approved by the superintendent or other persons under his direction and no such service pipes shall be covered until they have been so inspected.

(Code 1971, § 50.120; Ord. of 7-26-1954)

Sec. 94-66. - Connection from curbstop to premises.

Every person supplied with water from the village waterworks system shall, at his own cost and expense, have installed and kept in repair all pipes leading from the curbstop to his building, structure or premises as are supplied with water through such service pipe.

(Code 1971, § 50.100; Ord. of 7-26-1954)

Sec. 94-67. - Water meters.

- (a) *Required; exceptions.* All water consumers supplied by the village shall be supplied through meters only except that in cases where it is temporarily impracticable to set a meter, the use and consumption of water shall be governed by other applicable provisions of this article.
- (b) *Property of village.* All meters used in connection with the waterworks system shall be furnished only by the village and shall be and remain for all time the property of the village.
- (c) *Placement.* After the meter is placed, only officers or employees of the water department shall be allowed to repair, remove or in any manner interfere with the same. A meter stop or valve shall be placed on each side of the meter.
- (d) *Costs of repair.* The ordinary cost of keeping each meter in repair shall be paid by the village. The person upon whose application any meter is installed or the then owner or occupant of the premises served shall be jointly and severally liable for any breakage or damage done to such meter, including damage by freezing, hot water or breakage and also for the theft thereof and the cost of making good such loss or damage shall be paid by the owner or the occupant of the premises in which such meter was installed as soon as the bill for the same is presented and the amount therefor shall be a lien against the premises for which the meter was installed to the extent and with the same effect as water rates.
- (e) *Tampering prohibited.* No person shall injure, deface, mar, destroy or in any manner interfere with any meter. It shall be the duty of the owner or occupant to promptly notify the water department of defects in any such meter or of its failure to properly register the quantity of water passing through the same.
- (f) *Type to be installed.* The superintendent shall in all cases determine the kind and pattern of water meters to be installed and no other kind shall be installed at any time.
- (g)

Location. Water meters shall be located at such places and in such manner as the superintendent shall direct, within the premises to be served or in boxes or vaults as he shall determine and all such installations shall be made in accordance with the specifications to be prescribed by the superintendent and such meter locations must be so situated as to prevent freezing of water flowing through such meters.

(Code 1971, § 50.060; Ord. of 7-26-1954)

Secs. 94-68—94-92. - Reserved.

Appendix 2

Complete Lead Service Line Inventory



Lead Service Line Inventory Template

*Please enter information in the empty box next to each section	Water System Name	Phoenix	System ID Number:	IL0312490	Current Inventory Date:	4/15/2024						
*Please enter totals in the empty box next to each category	Total Service lines:	664	Total Lead:	310	Total Non-Lead:	0	Total Galvanized Requiring replacement:	56	Total Unknown:	298	Website link to Material Inventory:	gettheleadoutil.com

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadoutil.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
	Lead and Copper Sample site number is the 7 digit number starting with "LP" or "LA". / If address is not a lead and copper sample site mark "N/A"	EXAMPLES: Group Homes, Parks, Playgrounds, Special Care Facilities, Hospitals, Clinics, Child Care Facilities Yes (Y) or No (N)	Yes (Y) or No (N)	What year was the PWS-Owned service line installed, if known?	What year was the customer side service line installed, if known?	How was the Material of this Service Line Identified? EXAMPLES: Construction Records, Visual Inspections, Survey Response, Maintenance Records, etc...	EXAMPLES: Copper - No Lead Solder (C) Copper - Lead Solder (CLS) Galvanized (G) Lead (L) Cast/Ductile Iron or Transite (O) Plastic - PVC, HDPE, PEX (P) Unknown (U) Unknown Not Lead (UNL)	EXAMPLES: Copper - No Lead Solder (C) Copper - Lead Solder (CLS) Galvanized (G) Galvanized Requiring Replacement (GRR) Lead (L) Cast/Ductile Iron or Transite (O) Plastic - PVC, HDPE, PEX (P) Unknown (U) Unknown Not Lead (UNL)	EXAMPLES: Copper - No Lead Solder (C) Copper - Lead Solder (CLS) Galvanized (G) Galvanized Requiring Replacement (GRR) Lead (L) Cast/Ductile Iron or Transite (O) Plastic - PVC, HDPE, PEX (P) Unknown (U) Unknown Not Lead (UNL)	EXAMPLES: Lead (L) Galvanized Requiring Replacement (GRR) Non-Lead (NL)	If any galvanized service line material was ever downstream of a Lead section, mark Yes (Y). If the galvanized service line material was never downstream of any Lead section, mark No (N). / If Yes, that section of service line should be marked as Galvanized Requiring Replacement in the appropriate immediately preceding column(s).	Enter date customer was notified of Lead Service Line. / If Service Line is not Lead put N/R	Yes (Y) or No (N)	If previous column was marked (Y), provide date the Lead Service Line was replaced. / Leave blank if previous column was (N).	EXAMPLES: Copper - No Lead Solder (C) Galvanized (G) Plastic - PVC, HDPE, PEX (P) Cast/Ductile Iron or Transite (O) Leave blank if no Lead Service Line was replaced.	Yes (Y) or No (N)	IF customer refused access to property, date waiver obtained by PWS or date PWS notified IDPH of refusal to sign waiver. / Leave blank if customer has not refused access.
15100 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15101 HALSTED ST	N/A	N	N	Unknown	1916	Existing Records	U	U	C	U	N	N/R	N				
15101 HALSTED ST	N/A	N	N	Unknown	1925	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15103 SEVENTH AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	L	L	N	4/30/2024	N				
15104 9TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15104 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15104 SIXTH AVE	N/A	N	N	Unknown	2002	Existing Records	U	U	C	U	N	N/R	N				
15105 8TH AVE	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
15105 FIFTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15105 S 6TH AVE	N/A	N	N	Unknown	2002	Existing Records	U	U	C	U	N	N/R	N				
15106 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	C	U	N	N/R	N				
15108 8TH AVE	N/A	N	N	Unknown	2007	Existing Records	U	U	L	L	N	4/30/2024	N				
15108 NINTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15108 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15109 8TH AVE	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
15109 FIFTH AVE	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
15110 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15111 S 4TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15112 FIRST AVE	N/A	N	N	Unknown	1941	Age of Home	U	U	L	L	N	4/30/2024	N				
15112 SECOND AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	C	U	N	N/R	N				
15112 SEVENTH AVE	N/A	N	N	Unknown	1968	Existing Records	U	U	L	L	N	4/30/2024	N				
15113 HALSTED ST	N/A	N	N	Unknown	1965	Age of Home	U	U	L	L	N	4/30/2024	N				
15114 9TH AVE	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
15114 EIGHTH AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
15114 THIRD AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15115 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15115 FIFTH AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15115 FIRST AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	L	L	N	4/30/2024	N				
15115 S 2ND ST	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15115 S 4TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15115 SEVENTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15116 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/ Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15117 8TH AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15117 S 4TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15117 S 6TH AVE	N/A	N	N	Unknown	1953	Existing Records	U	U	C	U	N	N/R	N				
15117 SECOND AVE	N/A	N	N	Unknown	1912	Existing Records	U	U	C	U	N	N/R	N				
15118 EIGHTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15118 SECOND AVE	N/A	N	N	Unknown	1959	Age of Home	U	U	L	L	N	4/30/2024	N				
15118 THIRD AVE	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
15119 FIFTH AVE	N/A	N	N	Unknown	1959	Age of Home	U	U	L	L	N	4/30/2024	N				
15119 HALSTED ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15119 SECOND AVE	N/A	N	N	Unknown	1903	Existing Records	U	U	C	U	N	N/R	N				
15119 SECOND AVE	N/A	N	N	Unknown	1925	Existing Records	U	U	C	U	N	N/R	N				
15119 SEVENTH AVE	N/A	N	N	Unknown	1964	Age of Home	U	U	L	L	N	4/30/2024	N				
15120 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15121 SEVENTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15122 8TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15123 FIFTH AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15123 FIRST AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	L	L	N	4/30/2024	N				
15123 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15124 FIFTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15124 SECOND AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
15124 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15124 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15125 SEVENTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15126 8TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15126 9TH AVE	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15127 FIRST AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15127 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15128 FIFTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15128 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15128 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15129 FOURTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15129 SECOND AVE	N/A	N	N	Unknown	1893	Existing Records	U	U	C	U	N	N/R	N				
15129 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15130 SECOND AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15131 FIRST AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15131 HALSTED ST	N/A	N	N	Unknown	1903	Age of Home	U	U	L	L	N	4/30/2024	N				
15131 S 4TH AVE	N/A	N	N	Unknown	1963	Existing Records	U	U	L	L	N	4/30/2024	N				
15131 SIXTH AVE	N/A	N	N	Unknown	1968	Existing Records	U	U	L	L	N	4/30/2024	N				
15132 8TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15132 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15132 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15133 S 4TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15133 S 6TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15133 SEVENTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15135 FIFTH AVE	N/A	N	N	Unknown	1912	Existing Records	U	U	C	U	N	N/R	N				
15135 HALSTED ST	N/A	N	N	Unknown	1907	Existing Records	U	U	C	U	N	N/R	N				
15136 FIFTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15136 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15136 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15137 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15137 FIRST AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15137 S 6TH AVE	N/A	N	N	Unknown	1948	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15137 SEVENTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15140 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15140 S 5TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15140 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15140 SIXTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15141 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15141 SEVENTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15144 9TH AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	L	L	N	4/30/2024	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15145 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15149 EIGHTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15203 HALSTED ST	N/A	N	N	Unknown	1908	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15205 EIGHTH AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
15205 HALSTED ST	N/A	N	N	Unknown	1908	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15211 8TH AVE	N/A	N	N	Unknown	1953	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15211 S HALSTED ST	N/A	N	N	Unknown	1941	Existing Records	U	U	C	U	N	N/R	N				
15212 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15213 FIFTH AVE	N/A	Y	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15213 SEVENTH AVE	N/A	N	N	Unknown	1931	Existing Records	U	U	L	L	N	4/30/2024	N				
15213 SIXTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15214 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15215 EIGHTH AVE	N/A	N	N	Unknown	1939	Existing Records	U	U	C	U	N	N/R	N				
15215 FOURTH AVE	N/A	N	N	Unknown	1929	Existing Records	U	U	C	U	N	N/R	N				
15215 SIXTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15216 8TH AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15216 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15217 FOURTH AVE	N/A	N	N	Unknown	1923	Age of Home	U	U	L	L	N	4/30/2024	N				
15219 8TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15219 FIFTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	C	U	N	N/R	N				
15219 SIXTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	C	U	N	N/R	N				
15219 VINCENNES AVE	N/A	N	N	Unknown	1925	Existing Records	U	U	C	U	N	N/R	N				
15220 FIFTH AVE	N/A	N	N	Unknown	1968	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15220 S 6TH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15221 EIGHTH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
15221 S HALSTED ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
15221 SIXTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	C	U	N	N/R	N				
15223 VINCENNES AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
15224 SEVENTH AVE	N/A	N	N	Unknown	1957	Age of Home	U	U	L	L	N	4/30/2024	N				
15225 FIFTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	C	U	N	N/R	N				
15225 HALSTED ST	N/A	N	N	Unknown	2001	Age of Home	U	U	UNL	U	N	N/R	N				
15226 SEVENTH AVE	N/A	N	N	Unknown	1946	Age of Home	U	U	L	L	N	4/30/2024	N				
15227 FIFTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15227 FOURTH AVE	N/A	N	N	Unknown	1978	Existing Records	U	U	C	U	N	N/R	N				
15228 SIXTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15229 S 7TH AVE	N/A	N	N	Unknown	2007	Existing Records	U	U	C	U	N	N/R	N				
15231 EIGHTH AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
15232 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15232 FIFTH AVE	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
15232 WALTON AVE	N/A	N	N	Unknown	1909	Existing Records	U	U	C	U	N	N/R	N				
15233 EIGHTH AVE	N/A	N	N	Unknown	1983	Existing Records	U	U	C	U	N	N/R	N				
15233 FOURTH AVE	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15233 SIXTH AVE	N/A	N	N	Unknown	1925	Age of Home	U	U	L	L	N	4/30/2024	N				
15234 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15235 FIFTH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15235 VINCENNES AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
15236 8TH AVE	N/A	N	N	Unknown	1940	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15236 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15237 FIFTH AVE	N/A	N	N	Unknown	1955	Age of Home	U	U	L	L	N	4/30/2024	N				
15237 FOURTH AVE	N/A	N	N	Unknown	1916	Existing Records	U	U	L	L	N	4/30/2024	N				
15237 SIXTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15237 VINCENNES AVE	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15238 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15238 FIFTH AVE	N/A	N	N	Unknown	1903	Existing Records	U	U	C	U	N	N/R	N				
15238 S 4TH AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15239 VINCENNES AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	L	L	N	4/30/2024	N				
15240 8TH AVE	N/A	N	N	Unknown	2007	Existing Records	U	U	C	U	N	N/R	N				
15240 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15240 SIXTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
15241 8TH AVE	N/A	N	N	Unknown	1963	Existing Records	U	U	C	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15241 THIRD AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
15241 VINCENNES AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
15242 8TH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	L	L	N	4/30/2024	N				
15242 FIFTH AVE	N/A	N	N	Unknown	1974	Existing Records	U	U	C	U	N	N/R	N				
15242 S 4TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15243 S 7TH AVE	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15243 SIXTH AVE	N/A	N	N	Unknown	1914	Existing Records	U	U	C	U	N	N/R	N				
15243 THIRD AVE	N/A	N	N	Unknown	1903	Existing Records	U	U	L	L	N	4/30/2024	N				
15244 S 7TH AVE	N/A	N	N	Unknown	1905	Existing Records	U	U	C	U	N	N/R	N				
15244 WALTON AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15245 8TH AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15245 FOURTH AVE	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
15245 S 7TH AVE	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15246 FIFTH AVE	N/A	N	N	Unknown	1972	Existing Records	U	U	C	U	N	N/R	N				
15246 S 4TH AVE	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
15247 SEVENTH AVE	N/A	N	N	Unknown	2022	Age of Home	U	U	UNL	U	N	N/R	N				
15247 THIRD AVE	N/A	N	N	Unknown	1912	Existing Records	U	U	C	U	N	N/R	N				
15248 8TH AVE	N/A	N	N	Unknown	1995	Existing Records	U	U	C	U	N	N/R	N				
15249 FIFTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	C	U	N	N/R	N				
15249 S 7TH AVE	N/A	N	N	Unknown	2022	Age of Home	U	U	UNL	U	N	N/R	N				
15249 SIXTH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	C	U	N	N/R	N				
15250 S 3RD ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15250 S 3RD ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15250 S 4TH AVE	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
15250 S 4TH AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15252 SEVENTH AVE	N/A	N	N	Unknown	1903	Existing Records	U	U	C	U	N	N/R	N				
15253 FIFTH AVE	N/A	N	N	Unknown	1928	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15254 8TH AVE	N/A	N	N	Unknown	1995	Existing Records	U	U	C	U	N	N/R	N				
15254 FIFTH AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15254 SEVENTH AVE	N/A	N	N	Unknown	1953	Existing Records	U	U	L	L	N	4/30/2024	N				
15254 SIXTH AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	O	U	N	N/R	N				
15255 S 4TH AVE	N/A	N	N	Unknown	1929	Existing Records	U	U	C	U	N	N/R	N				
15255 SIXTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15256 VINCENNES AVE	N/A	N	N	Unknown	1941	Existing Records	U	U	L	L	N	4/30/2024	N				
15258 VINCENNES AVE	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15259 VINCENNES AVE	N/A	N	N	Unknown	1991	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15260 WALTON AVE	N/A	N	N	Unknown	1989	Existing Records	U	U	C	U	N	N/R	N				
15266 WALTON AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
15268 WALTON AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
15275 WELTON ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15301 THIRD AVE	N/A	N	N	Unknown	1973	Existing Records	U	U	C	U	N	N/R	N				
15307 HALSTED ST	N/A	N	N	Unknown	1933	Existing Records	U	U	C	U	N	N/R	N				
15311 THIRD AVE	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
15311 VINCENNES AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
15315 VINCENNES AVE	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
15315 VINCENNES AVE	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
15316 FOURTH AVE	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
15316 SEVENTH AVE	N/A	N	N	Unknown	1973	Existing Records	U	U	C	U	N	N/R	N				
15317 SIXTH AVE	N/A	N	N	Unknown	1974	Existing Records	U	U	C	U	N	N/R	N				
15318 FOURTH AVE	N/A	N	N	Unknown	1932	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15318 SEVENTH AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
15321 FIFTH AVE	N/A	N	N	Unknown	1930	Age of Home	U	U	L	L	N	4/30/2024	N				
15321 S 7TH AVE	N/A	N	N	Unknown	2006	Notified by Customer	U	U	C	U	N	N/R	N				
15322 8TH AVE	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				
15322 FOURTH AVE	N/A	N	N	Unknown	1921	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15322 NINTH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	L	L	N	4/30/2024	N				
15323 FOURTH AVE	N/A	N	N	Unknown	1969	Existing Records	U	U	L	L	N	4/30/2024	N				
15323 NINTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15323 S 7TH AVE	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				
15324 8TH AVE	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15324 NINTH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
15324 S 6TH AVE	N/A	N	N	Unknown	1974	Existing Records	U	U	C	U	N	N/R	N				
15325 FIFTH AVE	N/A	N	N	Unknown	1926	Age of Home	U	U	L	L	N	4/30/2024	N				
15325 SIXTH AVE	N/A	N	N	Unknown	1974	Existing Records	U	U	C	U	N	N/R	N				
15326 8TH AVE	N/A	N	N	Unknown	1964	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15326 SEVENTH AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
15327 EIGHTH AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	L	L	N	4/30/2024	N				
15327 FIRST AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15327 S 7TH AVE	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				
15328 NINTH AVE	N/A	N	N	Unknown	1924	Existing Records	U	U	C	U	N	N/R	N				
15328 S 6TH AVE	N/A	N	N	Unknown	2010	Existing Records	U	U	C	U	N	N/R	N				
15329 S 7TH AVE	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				
15330 FOURTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15330 SEVENTH AVE	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
15332 FIFTH AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
15332 S 6TH AVE	N/A	N	N	Unknown	2010	Existing Records	U	U	C	U	N	N/R	N				
15333 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15333 S 7TH AVE	N/A	N	N	Unknown	2008	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15333 THIRD AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15334 SEVENTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15335 EIGHTH AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
15335 FIFTH AVE	N/A	N	N	Unknown	1941	Existing Records	U	U	L	L	N	4/30/2024	N				
15335 S 7TH AVE	N/A	N	N	Unknown	1916	Existing Records	U	U	C	U	N	N/R	N				
15336 EIGHTH AVE	N/A	N	N	Unknown	1994	Existing Records	U	U	C	U	N	N/R	N				
15336 FOURTH AVE	N/A	N	N	Unknown	1922	Existing Records	U	U	C	U	N	N/R	N				
15336 NINTH AVE	N/A	N	N	Unknown	1922	Existing Records	U	U	C	U	N	N/R	N				
15336 SEVENTH AVE	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
15337 SIXTH AVE	N/A	N	N	Unknown	1920	Age of Home	U	U	L	L	N	4/30/2024	N				
15338 EIGHTH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15339 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15339 FIFTH AVE	N/A	N	N	Unknown	1878	Age of Home	U	U	L	L	N	4/30/2024	N				
15339 FOURTH AVE	N/A	N	N	Unknown	1968	Existing Records	U	U	C	U	N	N/R	N				
15341 FOURTH AVE	N/A	Y	N	Unknown	1925	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15342 FIFTH AVE	N/A	N	N	Unknown	1909	Existing Records	U	U	C	U	N	N/R	N				
15342 NINTH AVE	N/A	N	N	Unknown	1976	Existing Records	U	U	C	U	N	N/R	N				
15343 EIGHTH AVE	N/A	N	N	Unknown	1931	Age of Home	U	U	L	L	N	4/30/2024	N				
15344 S 7TH AVE	N/A	N	N	Unknown	1999	Existing Records	U	U	C	U	N	N/R	N				
15344 SIXTH AVE	N/A	N	N	Unknown	1958	Existing Records	U	U	L	L	N	4/30/2024	N				
15345 SIXTH AVE	N/A	N	N	Unknown	1919	Existing Records	U	U	C	U	N	N/R	N				
15347 EIGHTH AVE	N/A	N	N	Unknown	1916	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15347 S 5TH AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
15348 9TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15349 NINTH AVE	N/A	N	N	Unknown	1911	Existing Records	U	U	C	U	N	N/R	N				
15349 S 4TH AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
15350 SIXTH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
15351 S 3RD AVE	N/A	N	N	Unknown	1918	Age of Home	U	U	L	L	N	4/30/2024	N				
15352 NINTH AVE	N/A	N	N	Unknown	1949	Age of Home	U	U	L	L	N	4/30/2024	N				
15353 EIGHTH AVE	N/A	N	N	Unknown	1888	Existing Records	U	U	C	U	N	N/R	N				
15353 S 7TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15354 8TH AVE	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
15354 8TH AVE	N/A	N	N	Unknown	Unknown	Existing Records	U	U	L	L	N	4/30/2024	N				
15354 FIFTH AVE	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
15354 S 7TH AVE	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
15355 E 150TH ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
15356 FOURTH AVE	N/A	N	N	Unknown	1945	Existing Records	U	U	C	U	N	N/R	N				
15356 NINTH AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15356 SIXTH AVE	N/A	N	N	Unknown	1961	Age of Home	U	U	L	L	N	4/30/2024	N				
15357 EIGHTH AVE	N/A	N	N	Unknown	1928	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15357 FIFTH AVE	N/A	N	N	Unknown	1918	Age of Home	U	U	L	L	N	4/30/2024	N				
15357 S 7TH AVE	N/A	N	N	Unknown	1993	Existing Records	U	U	C	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15357 S 7TH AVE	N/A	N	N	Unknown	1919	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15357 SIXTH AVE	N/A	N	N	Unknown	1930	Existing Records	U	U	C	U	N	N/R	N				
15358 8TH AVE	N/A	N	N	Unknown	1934	Existing Records	U	U	C	U	N	N/R	N				
15358 SEVENTH AVE	N/A	N	N	Unknown	1994	Existing Records	U	U	C	U	N	N/R	N				
15360 NINTH AVE	N/A	N	N	Unknown	1928	Existing Records	U	U	C	U	N	N/R	N				
15360 SEVENTH AVE	N/A	N	N	Unknown	1994	Existing Records	U	U	C	U	N	N/R	N				
15360 SIXTH AVE	N/A	N	N	Unknown	1959	Existing Records	U	P	U	U	N	N/R	N				
15361 8TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15361 9TH AVE	N/A	N	N	Unknown	1972	Existing Records	U	U	C	U	N	N/R	N				
15361 FOURTH AVE	N/A	N	N	Unknown	1922	Existing Records	U	U	C	U	N	N/R	N				
15361 S 6TH AVE	N/A	N	N	Unknown	1924	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15361 S 7TH AVE	N/A	N	N	Unknown	1916	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15362 8TH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	C	U	N	N/R	N				
15362 FIFTH AVE	N/A	N	N	Unknown	1972	Existing Records	U	U	C	U	N	N/R	N				
15362 NINTH AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15362 S 7TH AVE	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
15363 8TH AVE	N/A	N	N	Unknown	1946	Existing Records	U	U	L	L	N	4/30/2024	N				
15363 9TH AVE	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
15363 S 5TH AVE	N/A	N	N	Unknown	1938	Existing Records	U	U	C	U	N	N/R	N				
15365 SIXTH AVE	N/A	N	N	Unknown	1925	Existing Records	U	U	C	U	N	N/R	N				
15366 8TH AVE	N/A	N	N	Unknown	2006	Age of Home	U	U	UNL	U	N	N/R	N				
15367 FOURTH AVE	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
15367 NINTH AVE	N/A	N	N	Unknown	1943	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15367 S 5TH AVE	N/A	N	N	Unknown	1972	Notified by Customer	U	U	L	L	N	4/30/2024	N				
15367 THIRD AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	L	L	N	4/30/2024	N				
15400 VINCENNES AVE	N/A	N	N	Unknown	1946	Existing Records	U	U	L	L	N	4/30/2024	N				
15403 VINCENNES AVE	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
15406 VINCENNES AVE	N/A	N	N	Unknown	1900	Existing Records	U	U	L	L	N	4/30/2024	N				
15409 VINCENNES AVE	N/A	N	N	Unknown	1922	Existing Records	U	U	C	U	N	N/R	N				
15413 VINCENNES AVE	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
15417 VINCENNES AVE	N/A	N	N	Unknown	1957	Age of Home	U	U	L	L	N	4/30/2024	N				
15425 VINCENNES AVE	N/A	N	N	Unknown	1908	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15430 VINCENNES AVE	N/A	N	N	Unknown	1905	Notified by Customer	U	U	GRR	GRR	Y	4/30/2024	N				
15447 VINCENNES AVE	N/A	N	N	Unknown	1933	Age of Home	U	U	L	L	N	4/30/2024	N				
15501 SIXTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15505 SIXTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15509 SIXTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15509 VINCENNES AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15513 SIXTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15513 VINCENNES AVE	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
15517 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15521 SIXTH AVE	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
15525 SIXTH AVE	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
15526 VINCENNES AVE	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15527 SIXTH AVE	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
15529 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15529 VINCENNES AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15532 VINCENNES AVE	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
15533 FOURTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15533 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	C	U	N	N/R	N				
15533 VINCENNES AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15534 VINCENNES AVE	N/A	N	N	Unknown	1916	Existing Records	U	U	C	U	N	N/R	N				
15536 VINCENNES AVE	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
15537 S 4TH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15537 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15537 VINCENNES AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15541 FOURTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
15541 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	C	U	N	N/R	N				
15541 VINCENNES AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15545 SIXTH AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
15545 VINCENNES AVE	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
15549 S VINCENNES RD	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
155TH & 7TH AVE	N/A	Y	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
17022 WALTON AVE	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
17346 HALSTED ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
500 E 154TH ST	N/A	N	N	Unknown	1901	Age of Home	U	U	L	L	N	4/30/2024	N				
501 E 155TH ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
503 E 154TH ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
506 E 154TH PL	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
506 E 154TH ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
509 BELLE CT	N/A	N	N	Unknown	1925	Existing Records	U	U	C	U	N	N/R	N				
509 E 153RD ST	N/A	N	N	Unknown	2007	Age of Home	U	U	UNL	U	N	N/R	N				
512 E 153RD ST	N/A	N	N	Unknown	1922	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
512 FRANCES ST	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
513 BELLE CT	N/A	N	N	Unknown	Unknown	Existing Records	U	U	L	L	N	4/30/2024	N				
513 E 154TH ST	N/A	N	N	Unknown	1908	Existing Records	U	U	L	L	N	4/30/2024	N				
514 E 154TH PL	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
515 BELLE CT	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
516 E 153RD ST	N/A	N	N	Unknown	1915	Existing Records	U	U	C	U	N	N/R	N				
516 FRANCES ST	N/A	N	N	Unknown	1951	Existing Records	U	U	C	U	N	N/R	N				
518 E 152ND ST	N/A	N	N	Unknown	1923	Age of Home	U	U	L	L	N	4/30/2024	N				
518 E 155TH ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
518 FRANCES ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
519 E 153RD ST	N/A	N	N	Unknown	1913	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
520 E 152ND ST	N/A	N	N	Unknown	1958	Existing Records	U	U	L	L	N	4/30/2024	N				
520 E 154TH PL	N/A	N	N	Unknown	1918	Existing Records	U	U	L	L	N	4/30/2024	N				
521 153RD PL	N/A	N	N	Unknown	Unknown	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
521 E 151ST ST	N/A	N	N	Unknown	1913	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
522 FRANCES ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
523 E 151ST ST	N/A	N	N	Unknown	1927	Existing Records	U	U	L	L	N	4/30/2024	N				
523 E 152ND ST	N/A	N	N	Unknown	1920	Age of Home	U	U	L	L	N	4/30/2024	N				
523 E 154TH ST	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
523 E 154TH ST	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
524 E 154TH PL	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
524 E 155TH ST	N/A	N	N	Unknown	1916	Age of Home	U	U	L	L	N	4/30/2024	N				
526 E 152ND ST	N/A	N	N	Unknown	1924	Existing Records	U	U	C	U	N	N/R	N				
526 E 154TH PL	N/A	N	N	Unknown	1958	Existing Records	U	U	C	U	N	N/R	N				
530 FRANCES ST	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
531 E 151ST ST	N/A	N	N	Unknown	1929	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
531 E 154TH PL	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
531 E 154TH ST	N/A	N	N	Unknown	1907	Existing Records	U	U	C	U	N	N/R	N				
532 E 155TH ST	N/A	N	N	Unknown	1907	Existing Records	U	U	L	L	N	4/30/2024	N				
534 E 152ND ST	N/A	N	N	Unknown	1898	Age of Home	U	U	L	L	N	4/30/2024	N				
534 E 155TH ST	N/A	N	N	Unknown	1892	Existing Records	U	U	C	U	N	N/R	N				
535 E 154TH PL	N/A	N	N	Unknown	1924	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
535 E 155TH ST	N/A	N	N	Unknown	1910	Existing Records	U	U	C	U	N	N/R	N				
536 E 155TH ST	N/A	N	N	Unknown	1949	Age of Home	U	U	L	L	N	4/30/2024	N				
537 E 151ST ST	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
538 E 154TH PL	N/A	N	N	Unknown	1928	Existing Records	U	U	C	U	N	N/R	N				
539 E 151ST ST	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
540 E 154TH PL	N/A	N	N	Unknown	1918	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
540 FRANCES ST	N/A	N	N	Unknown	1985	Existing Records	U	U	C	U	N	N/R	N				
541 E 152ND ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
541 E 154TH PL	N/A	N	N	Unknown	1922	Age of Home	U	U	L	L	N	4/30/2024	N				
545 E 154TH PL	N/A	N	N	Unknown	1910	Existing Records	U	U	C	U	N	N/R	N				
546 E 155TH ST	N/A	N	N	Unknown	1916	Existing Records	U	U	C	U	N	N/R	N				
548 E 155TH ST	N/A	N	N	Unknown	1910	Existing Records	U	U	C	U	N	N/R	N				
549 E 154TH PL	N/A	N	N	Unknown	1912	Existing Records	U	U	C	U	N	N/R	N				
549 E 155TH ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
550 E 155TH ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
554 E 155TH ST	N/A	N	N	Unknown	1912	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
558 E 155TH ST	N/A	N	N	Unknown	1919	Existing Records	U	U	C	U	N	N/R	N				
559 E 155TH ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
563 E 155TH ST	N/A	N	N	Unknown	1907	Age of Home	U	U	L	L	N	4/30/2024	N				
602 E 152ND ST	N/A	N	N	Unknown	1921	Existing Records	U	U	L	L	N	4/30/2024	N				
604 BELLE CT	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
605 E 153RD ST	N/A	N	N	Unknown	2000	Existing Records	U	U	C	U	N	N/R	N				
606 E 152ND ST	N/A	N	N	Unknown	1918	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
608 BELLE CT	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
609 E 152ND ST	N/A	N	N	Unknown	1949	Existing Records	U	U	C	U	N	N/R	N				
609 E 153RD ST	N/A	N	N	Unknown	1928	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
611 E 151ST ST	N/A	N	N	Unknown	1966	Age of Home	U	U	L	L	N	4/30/2024	N				
611 E 153RD ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
612 153RD PL	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
612 FRANCES ST	N/A	N	N	Unknown	2004	Existing Records	U	U	C	U	N	N/R	N				
614 FRANCES ST	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
615 E 153RD ST	N/A	N	N	Unknown	1903	Existing Records	U	U	C	U	N	N/R	N				
615 FRANCES ST	N/A	N	N	Unknown	1924	Existing Records	U	U	L	L	N	4/30/2024	N				
616 E 154TH PL	N/A	N	N	Unknown	2006	Age of Home	U	U	UNL	U	N	N/R	N				
617 E 152ND ST	N/A	N	N	Unknown	1928	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
619 E 153RD ST	N/A	N	N	Unknown	1957	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
619 E 155TH ST	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
619 E FRANCES ST	N/A	N	N	Unknown	2001	Age of Home	U	U	UNL	U	N	N/R	N				
619 WEDGEWOOD AVE	N/A	N	N	Unknown	1903	Existing Records	U	U	C	U	N	N/R	N				
621 E 154TH ST	N/A	N	N	Unknown	1958	Age of Home	U	U	L	L	N	4/30/2024	N				
621 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
621 E 155TH ST	N/A	N	N	Unknown	1993	Existing Records	U	U	L	L	N	4/30/2024	N				
621 E 155TH ST	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
621 FRANCES ST	N/A	N	N	Unknown	1925	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
622 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
623 E 153RD ST	N/A	N	N	Unknown	1958	Existing Records	U	U	L	L	N	4/30/2024	N				
624 BELLE CT	N/A	N	N	Unknown	1926	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
624 E 151ST PL	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
624 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
625 E 152ND ST	N/A	N	N	Unknown	1976	Existing Records	U	U	C	U	N	N/R	N				
625 E 154TH PL	N/A	N	N	Unknown	1916	Existing Records	U	U	C	U	N	N/R	N				
625 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
625 E 155TH ST	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
625 FRANCES ST	N/A	N	N	Unknown	1926	Age of Home	U	U	L	L	N	4/30/2024	N				
626 E 154TH ST	N/A	N	N	Unknown	2008	Age of Home	U	U	UNL	U	N	N/R	N				
627 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
627 E 155TH ST	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
628 E 152ND ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
628 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
629 E 152ND ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
629 E 153RD ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
629 E 154TH ST	N/A	N	N	Unknown	1913	Age of Home	U	U	L	L	N	4/30/2024	N				
630 BELLE CT	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
630 E 152ND ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
630 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
631 E 154TH PL	N/A	N	N	Unknown	1923	Existing Records	U	U	L	L	N	4/30/2024	N				
631 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
632 E 155TH ST	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
632 FRANCES ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
633 E 153RD ST	N/A	N	N	Unknown	1921	Existing Records	U	U	C	U	N	N/R	N				
633 E 155TH ST	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
633 FRANCES ST	N/A	N	N	Unknown	1962	Existing Records	U	U	L	L	N	4/30/2024	N				
634 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
635 E 151ST ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
635 E 151ST ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
635 E 151ST ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
635 E 151ST ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
635 E 151ST ST	N/A	N	N	Unknown	Unknown	N/A	U	U	U	U	N	N/R	N				
635 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
635 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
636 E 153RD ST	N/A	N	N	Unknown		Existing Records	U	U	C	U	N	N/R	N				
636 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
637 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
637 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
638 E 155TH ST	N/A	N	N	Unknown	1917	Existing Records	U	U	C	U	N	N/R	N				
639 E 152ND ST	N/A	N	N	Unknown	1954	Existing Records	U	U	L	L	N	4/30/2024	N				
640 E 151ST PL	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
640 E 152ND ST	N/A	N	N	Unknown	1941	Existing Records	U	U	C	U	N	N/R	N				
640 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
640 FRANCES ST	N/A	N	N	Unknown	1949	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
641 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
641 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
643 E 151ST PL	N/A	N	N	Unknown	Unknown	Existing Records	U	U	O	U	N	N/R	N				
644 E 155TH PL	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
644 E 155TH PL	N/A	N	N	Unknown	1906	Existing Records	U	U	C	U	N	N/R	N				
645 E 155TH ST	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
645 E 155TH ST	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
646 FRANCES ST	N/A	N	N	Unknown	1918	Age of Home	U	U	L	L	N	4/30/2024	N				
648 FRANCES ST	N/A	N	N	Unknown	1918	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
649 E 153RD ST	N/A	N	N	Unknown	1933	Existing Records	U	U	C	U	N	N/R	N				
650 E 153RD ST	N/A	N	N	Unknown	1911	Age of Home	U	U	L	L	N	4/30/2024	N				
650 E 155TH ST	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
651 FRANCES ST	N/A	N	N	Unknown	1926	Existing Records	U	U	C	U	N	N/R	N				
652 FRANCES ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
653 FRANCES ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
655 E 153RD ST	N/A	N	N	Unknown	1940	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
700 E 155TH ST	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
701 E 151ST ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	L	L	N	4/30/2024	N				
701 E 152ND ST	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
702 E 152ND ST	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
702 E 153RD ST	N/A	N	N	Unknown	1999	Existing Records	U	U	C	U	N	N/R	N				
704 E 155TH ST	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
705 E 153RD ST	N/A	N	N	Unknown	1943	Existing Records	U	U	C	U	N	N/R	N				
706 E 153RD ST	N/A	N	N	Unknown	1893	Existing Records	U	U	C	U	N	N/R	N				
707 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
708 E 155TH ST	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
709 E 152ND ST	N/A	N	N	Unknown	1928	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
710 E 153RD ST	N/A	N	N	Unknown	1914	Existing Records	U	U	C	U	N	N/R	N				
710 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
711 E 153RD ST	N/A	N	N	Unknown	1898	Existing Records	U	U	C	U	N	N/R	N				
711 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
711 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
711 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
712 E 152ND ST	N/A	N	N	Unknown	1951	Existing Records	U	U	L	L	N	4/30/2024	N				
712 E 153RD ST	N/A	N	N	Unknown	1913	Existing Records	U	U	C	U	N	N/R	N				
713 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
714 E 155TH CT	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
714 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
715 E 152ND ST	N/A	N	N	Unknown	1952	Existing Records	U	U	L	L	N	4/30/2024	N				
715 E 153RD ST	N/A	N	N	Unknown	1893	Notified by Customer	U	U	L	L	N	4/30/2024	N				
715 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
715 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
715 E 155TH ST	N/A	N	N	Unknown	1956	Age of Home	U	U	L	L	N	4/30/2024	N				
716 E 155TH CT	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
716 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/ Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
717 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
717 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
717 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
718 E 152ND ST	N/A	N	N	Unknown	1924	Age of Home	U	U	L	L	N	4/30/2024	N				
718 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
718 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
719 E 153RD ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
719 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
719 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
719 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
720 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
720 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
721 E 152ND ST	N/A	N	N	Unknown	1952	Existing Records	U	U	L	L	N	4/30/2024	N				
721 E 155TH CT	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
721 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
721 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
722 E 155TH CT	N/A	N	N	Unknown	1958	Existing Records	U	U	L	L	N	4/30/2024	N				
722 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
723 E 152ND ST	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
723 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
723 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
723 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
724 E 153RD ST	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
724 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
724 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
724 E 155TH ST	N/A	N	N	Unknown	1910	Existing Records	U	U	C	U	N	N/R	N				
725 E 152ND ST	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
725 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
725 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
725 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
726 E 155TH ST	N/A	N	N	Unknown	1924	Existing Records	U	U	C	U	N	N/R	N				
727 E 153RD ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
727 E 153RD ST	N/A	N	N	Unknown	1930	Existing Records	U	U	C	U	N	N/R	N				
727 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
727 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
727 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
728 E 153RD ST	N/A	N	N	Unknown	1968	Existing Records	U	U	C	U	N	N/R	N				
728 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
728 E 155TH PL	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
729 E 153RD ST	N/A	N	N	Unknown	1972	Existing Records	U	U	C	U	N	N/R	N				
730 E 153RD ST	N/A	N	N	Unknown	1968	Existing Records	U	U	C	U	N	N/R	N				
730 E 155TH CT	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
730 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
731 E 152ND ST	N/A	N	N	Unknown	1964	Existing Records	U	U	L	L	N	4/30/2024	N				
731 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
731 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
731 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
732 E 152ND ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
732 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
732 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
733 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
733 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
733 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
734 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
734 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
735 E 152ND ST	N/A	N	N	Unknown	1966	Existing Records	U	U	L	L	N	4/30/2024	N				
735 E 153RD ST	N/A	N	N	Unknown	1955	Existing Records	U	U	L	L	N	4/30/2024	N				
735 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
735 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
735 E 155TH ST	N/A	N	N	Unknown	1960	Age of Home	U	U	L	L	N	4/30/2024	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
736 E 152ND ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
736 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
736 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
737 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
737 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
737 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
738 E 155TH CT	N/A	N	N	Unknown	1959	Existing Records	U	P	U	U	N	N/R	N				
738 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
739 E 152ND ST	N/A	N	N	Unknown	1964	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
740 E 153RD ST	N/A	N	N	Unknown	1980	Age of Home	U	U	UNL	U	N	N/R	N				
741 E 152ND ST	N/A	N	N	Unknown	1966	Existing Records	U	U	L	L	N	4/30/2024	N				
741 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
741 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
741 E 155TH ST	N/A	N	N	Unknown	1956	Notified by Customer	U	U	L	L	N	4/30/2024	N				
743 E 155TH CT	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
744 E 155TH PL	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
745 E 155TH CT	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
745 E 155TH PL	N/A	N	N	Unknown	1957	Existing Records	U	U	L	L	N	4/30/2024	N				
745 E 155TH ST	N/A	N	N	Unknown	1956	Existing Records	U	U	L	L	N	4/30/2024	N				
747 E 155TH CT	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
800 E 152ND ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
800 E 153RD ST	N/A	N	N	Unknown	1965	Existing Records	U	U	L	L	N	4/30/2024	N				
801 E 153RD ST	N/A	N	N	Unknown	1970	Existing Records	U	U	C	U	N	N/R	N				
804 E 155TH ST	N/A	N	N	Unknown	1920	Existing Records	U	U	C	U	N	N/R	N				
805 E 152ND ST	N/A	N	N	Unknown	2010	Existing Records	U	U	L	L	N	4/30/2024	N				
808 E 155TH ST	N/A	N	N	Unknown	1912	Existing Records	U	U	C	U	N	N/R	N				
809 E 153RD ST	N/A	N	N	Unknown	1976	Existing Records	U	U	C	U	N	N/R	N				
810 E 153RD ST	N/A	N	N	Unknown	1908	Existing Records	U	U	C	U	N	N/R	N				
811 E 152ND ST	N/A	N	N	Unknown	1964	Age of Home	U	U	L	L	N	4/30/2024	N				
813 E 153RD ST	N/A	N	N	Unknown	1945	Existing Records	U	U	C	U	N	N/R	N				
814 E 155TH ST	N/A	N	N	Unknown	1928	Age of Home	U	U	L	L	N	4/30/2024	N				
820 E 153RD ST	N/A	N	N	Unknown	1897	Age of Home	U	U	L	L	N	4/30/2024	N				
824 E 152ND ST	N/A	N	N	Unknown	1960	Existing Records	U	U	L	L	N	4/30/2024	N				
826 E 155TH ST	N/A	N	N	Unknown	1925	Age of Home	U	U	L	L	N	4/30/2024	N				
827 E 153RD ST	N/A	N	N	Unknown	1926	Existing Records	U	U	L	L	N	4/30/2024	N				
828 E 155TH ST	N/A	N	N	Unknown	1929	Existing Records	U	U	C	U	N	N/R	N				
829 E 153RD ST	N/A	N	N	Unknown	1948	Existing Records	U	U	L	L	N	4/30/2024	N				
830 E 152ND ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
831 E 153RD ST	N/A	N	N	Unknown	1971	Age of Home	U	U	UNL	U	N	N/R	N				
832 E 153RD ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
833 E 152ND ST	N/A	N	N	Unknown	1932	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
834 E 152ND ST	N/A	N	N	Unknown	1926	Existing Records	U	U	L	L	N	4/30/2024	N				
834 E 152ND ST	N/A	N	N	Unknown	1959	Existing Records	U	U	L	L	N	4/30/2024	N				
834 E 153RD ST	N/A	N	N	Unknown	1923	Existing Records	U	U	C	U	N	N/R	N				
838 E 152ND ST	N/A	N	N	Unknown	1961	Age of Home	U	U	L	L	N	4/30/2024	N				
838 E 155TH ST	N/A	N	N	Unknown	1989	Existing Records	U	U	C	U	N	N/R	N				
840 E 152ND ST	N/A	N	N	Unknown	1963	Existing Records	U	U	C	U	N	N/R	N				
840 E 155TH ST	N/A	N	N	Unknown	1912	Existing Records	U	U	L	L	N	4/30/2024	N				
841 E 152ND ST	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
845 E 152ND ST	N/A	N	N	Unknown	Unknown	Existing Records	U	U	C	U	N	N/R	N				
900 E 153RD ST	N/A	N	N	Unknown	2006	Existing Records	U	U	C	U	N	N/R	N				
900 E 155TH ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
903 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
905 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
906 E 152ND PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
906 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
906 W 151ST PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
907 E 152ND PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
907 E 152ND ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
907 MILLER PL	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				

Service Address	Lead and Copper Sample site number.	Is this a high-risk Facility or Area?	Service Line Newly Identified Since Last Submitted Inventory	Year PWS-Owned Service Line was Installed	Year Customer Side Service Line was Installed	Source of Information Used for Service Line Identification	Gooseneck/Pigtail	PWS-Owned Service Line Material	Customer Side Service Line Material	gettheleadout.com	Was Galvanized Service Line Material ever downstream of Lead?	Date Customer Notified of Lead Service Line	Was a Lead Service Line Previously Replaced at this Location?	Date Lead Service Line Replaced	Material of Service Line Replacement	Has the customer refused access to the property?	Date of customer waiver or IDPH notification, if customer refused access to property
908 E 152ND PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
908 E 155TH ST	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
908 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
908 W 151ST PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
909 E 152ND PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
909 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
910 E 151ST PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
910 E 152ND PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
910 E 155TH ST	N/A	N	N	Unknown	1926	Age of Home	U	U	L	L	N	4/30/2024	N				
910 MILLER PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
911 E 152ND ST	N/A	N	N	Unknown	1996	Existing Records	U	U	GRR	GRR	Y	4/30/2024	N				
912 E 152ND PL	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
912 MILLER PL	N/A	N	N	Unknown	1997	Age of Home	U	U	UNL	U	N	N/R	N				
912 W 151ST PL	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
913 E 152ND ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
914 E 155TH ST	N/A	N	N	Unknown	1918	Existing Records	U	U	C	U	N	N/R	N				
915 E 151ST ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
916 E 152ND ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
918 E 155TH ST	N/A	N	N	Unknown	1994	Age of Home	U	U	UNL	U	N	N/R	N				
919 E 151ST ST	N/A	N	N	Unknown	1961	Existing Records	U	U	C	U	N	N/R	N				
920 W 153RD ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
922 E 155TH ST	N/A	N	N	Unknown	1995	Existing Records	U	U	C	U	N	N/R	N				
922 E 155TH ST	N/A	N	N	Unknown	1995	Existing Records	U	U	C	U	N	N/R	N				
923 E 151ST ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
924 W 153RD ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
927 E 151ST ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
928 W 153RD ST	N/A	N	N	Unknown	1996	Existing Records	U	U	C	U	N	N/R	N				
931 E 151ST ST	N/A	N	N	Unknown	1961	Existing Records	U	U	L	L	N	4/30/2024	N				
931 MILLER PL	N/A	N	N	Unknown	1998	Existing Records	U	U	C	U	N	N/R	N				
933 MILLER PL	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				
934 E 153RD ST	N/A	N	N	Unknown	1920	Existing Records	U	U	C	U	N	N/R	N				
935 MILLER PL	N/A	N	N	Unknown	1997	Existing Records	U	U	C	U	N	N/R	N				

Appendix 3 Building Age Map

Appendix 4 Water Rates

DIVISION 2. - WATER SERVICE

Sec. 94-21. - Prohibition on purchase of water.

No person having his residence or place of business within the territorial limits of the village shall be permitted to buy water from any other village corporation or other public utility for such residence or place of business located in the village whenever the waterworks system of the village is adjacent to its property.

(Code 1971, § 50.080; Ord. of 7-26-1954)

Sec. 94-22. - Applications; connections.

- (a) *Form.* Any person or corporation desiring to make any connections with the waterworks system or plant or use water therefrom shall first make application to the superintendent upon a blank form or forms furnished by the water department. The application for connection to the water system shall be accompanied by a connection fee in the amount established by the board of trustees.
- (b) *Agreement required.* The application shall contain an agreement on the part of the applicant that all the rules, regulations, conditions and provisions of this Code and any ordinance relating to the waterworks system will be complied with and that all water rates, assessments and rents and all fines and penalties assessed, charged or imposed against the applicant upon the property described in the application will be paid.
- (c) *Issuance.* When the applicant has complied with all of the provisions of this article and other village law, a permit shall be issued by the superintendent authorizing the connection to be made and specifying the size thereof.

(Code 1971, § 50.055; Ord. of 7-26-1954)

Sec. 94-23. - Rates for water used.

- (a) All water being supplied by the village shall be charged the following rate for each billing period for each 1,000 gallons of water consumption or fraction thereof, at the rate established as follows:
Effective September 1, 2017 the rate shall be \$29.65 for the first 2,000 Gallons plus \$12.57 for each additional 1,000 gallons or fraction thereof, plus any increases charged by the supplier of water to the village.

(b) There shall be a minimum charge for water service of \$29.65 per billing period.

(c) At the discretion of the board, rates in (a) and (b) may increase by five percent, on May 1, annually.

(Code 1971, § 50.070; Ord. of 7-26-1954; Ord. No. 083117, § 1, 8-31-2017)

Sec. 94-24. - Rates for nonresidents.

All consumers of water furnished by the village occupying premises not within the limits of said village shall be charged rates equivalent to 150 percent of the respective rates applicable to consumers of water occupying premises within the limits of the village.

(Code 1971, § 50.075; Ord. of 7-26-1954)

Sec. 94-25. - Multiple units served by one meter.

Where more than one dwelling unit, premises or business establishments are served by one water meter, then there shall be an additional monthly service charge in the amount established by the board of trustees for each such additional dwelling unit, premises or business establishment served.

(Code 1971, § 50.305; Ord. of 7-26-1954)

Sec. 94-26. - Payment of water charges.

(a) *Required.* The services of the waterworks system are furnished to the respective premises by the village only upon the condition that the owner of the premises, the occupant thereof and the user of the service are jointly and severally liable therefor to the village.

(b) *Water statements.* It shall be the duty of the superintendent of the water department to cause statements for water charges to be delivered to each customer of the waterworks system at such intervals as will be determined by the president and board of trustees but in no event at any greater interval than three months.

(c) *Due date; penalty.* All water charges shall be due and payable on or before the tenth day after the date when the statements of such charges are rendered. All bills not paid within ten days of the date of billing shall have a penalty charge of ten percent added thereto.

(d) *Monthly minimum.* When the water is shut off temporarily at the request of any consumer and the meter is not removed, the consumer shall pay the regular minimum rate per month.

- (e) *Termination of service; notice.* Any person or party who shall vacate any premises, or any party who shall enter upon and occupy any premises, shall immediately, before vacating the premises or removing to other premises, notify the water department and secure a reading of the meter.

(Code 1971, §§ 50.085, 50.310; Ord. of 7-26-1954)

Sec. 94-27. - Delinquent bills; lien.

- (a) *Date delinquent.* In the event such charges for water service are not paid within 30 days after the rendition of the bill for services, the charges shall be deemed delinquent and thereafter shall constitute liens upon the real estate upon or for which the waterworks services have been supplied, and the water shall be turned off from the premises of the delinquent consumer. Service shall not be resumed until all arrearages, including penalties, delinquency fees, and shutoff and cut on fees as established by the board of trustees, have been paid.
- (b) *Statement of lien.* The superintendent of the water department is hereby directed to file sworn statements showing such delinquencies in the office of the county recorder of deeds which shall be deemed notice of the lien for payment of such waterworks service; provided, however, the village may refrain from filing such a statement of delinquencies if the village proposes to sue or shall have sued the owner, occupant or user of the real estate in a civil action to recover such delinquent charges.
- (c) *Service at different location.* No person owing water charges and moving to other premises where there are water connections or where connections shall afterwards be made shall be supplied with water until such charges in arrears are paid in full.

(Code 1971, §§ 50.085, 50.310; Ord. of 7-26-1954)


Sec. 94-28. - Right of entry.

The superintendent and every person authorized by him and all meter inspectors shall have ready access to the premises, place or buildings where such meters are located for the purpose of reading, examining, testing and repairing the same, and examining and testing the consumption, use and flow of water, and it shall be unlawful for any person to interfere with, prevent or obstruct the superintendent or such other person or inspector in his work hereunder. Every consumer of water shall take the same upon the conditions prescribed in this article.

(Code 1971, § 50.065; Ord. of 7-26-1954)

Secs. 94-29—94-59. - Reserved.

Appendix 5 LSLR Details

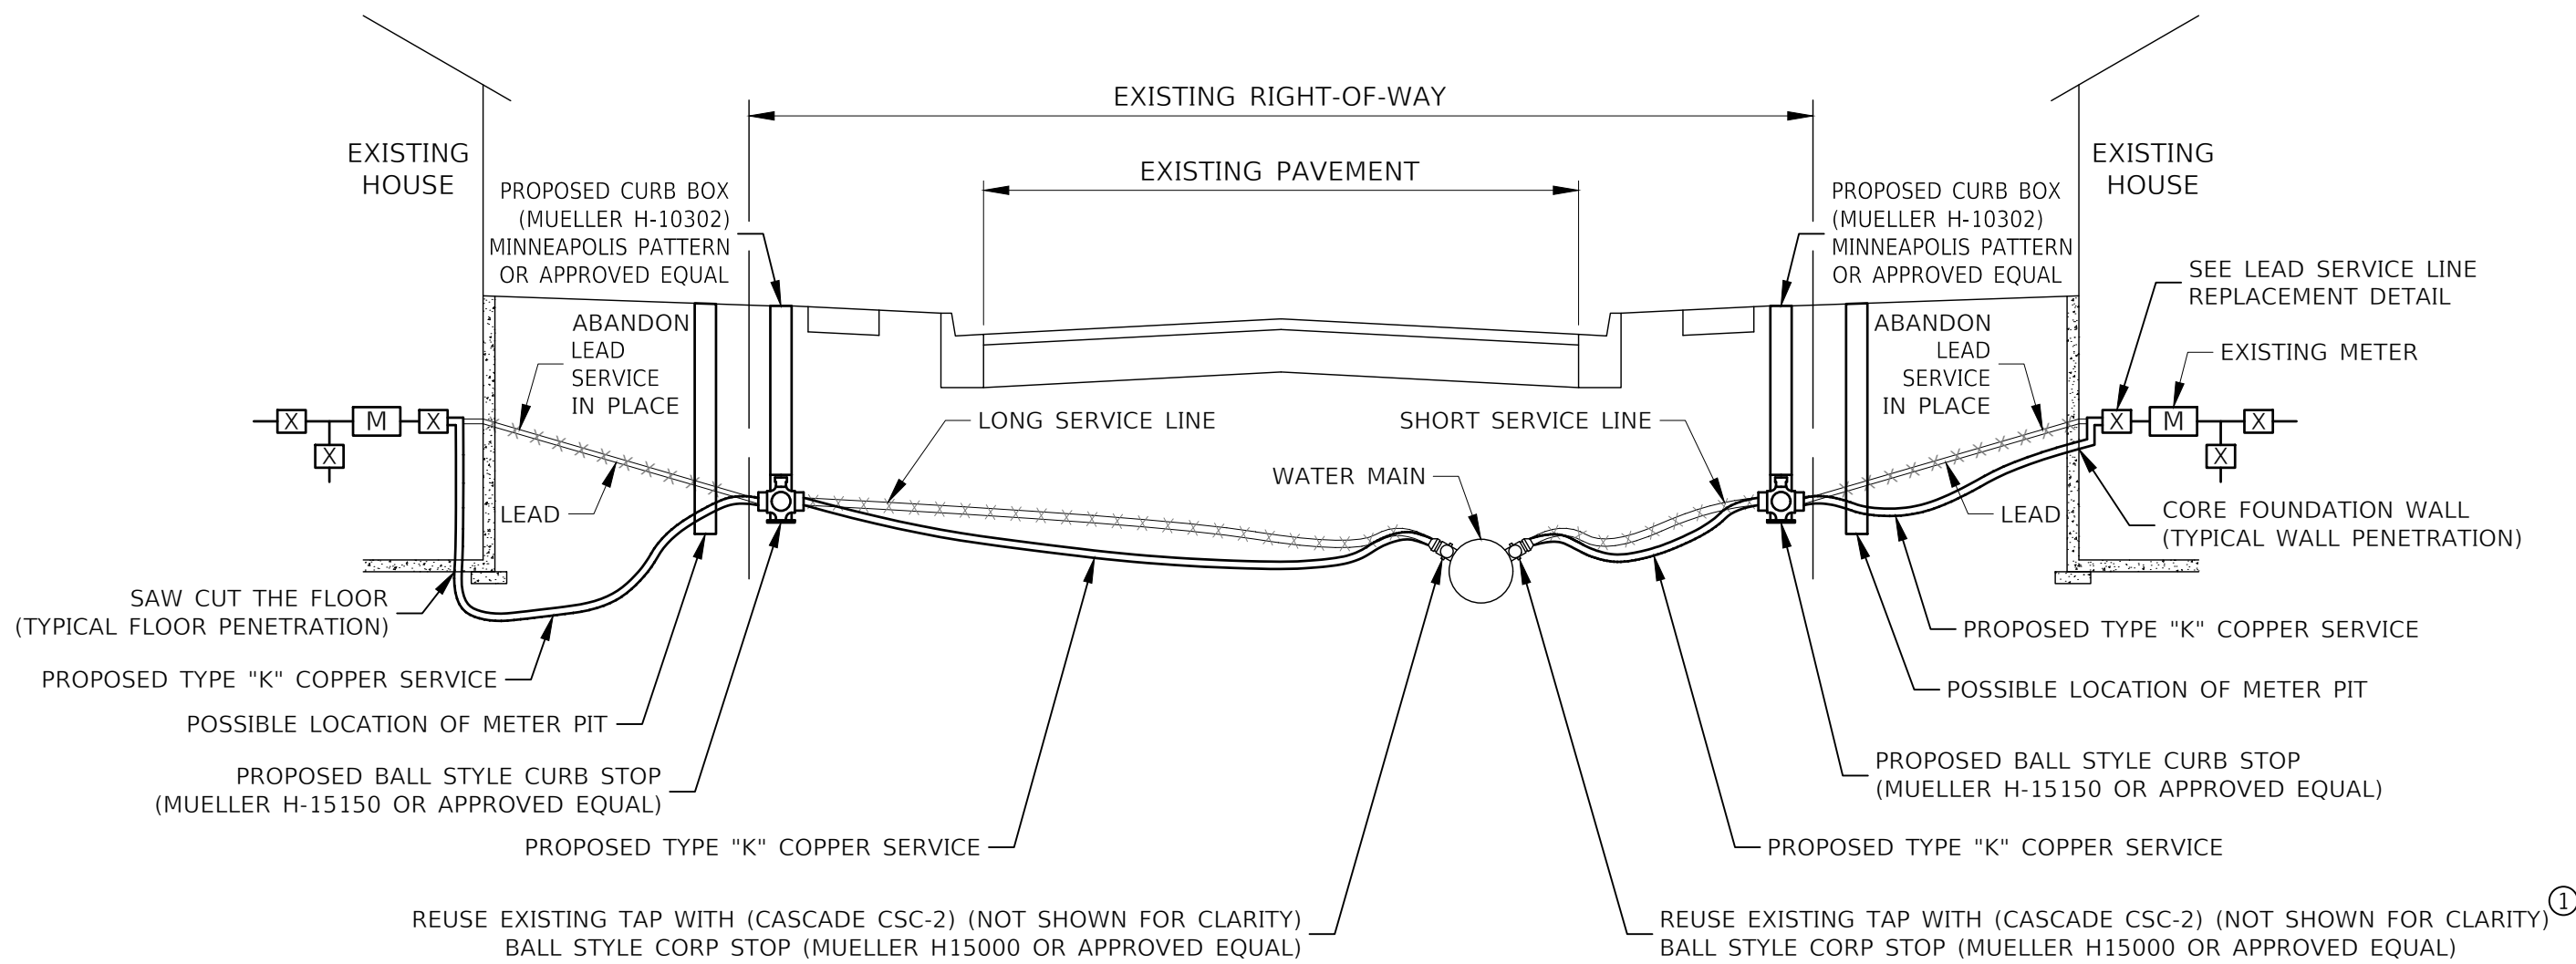


NOTE:
 ① SEE SPECIFICATIONS FOR WATER MAIN TAPPING.

FULL LEAD WATER SERVICE REPLACEMENT
 (COPPER)



22R0906_02-LSLR-DTLS-01

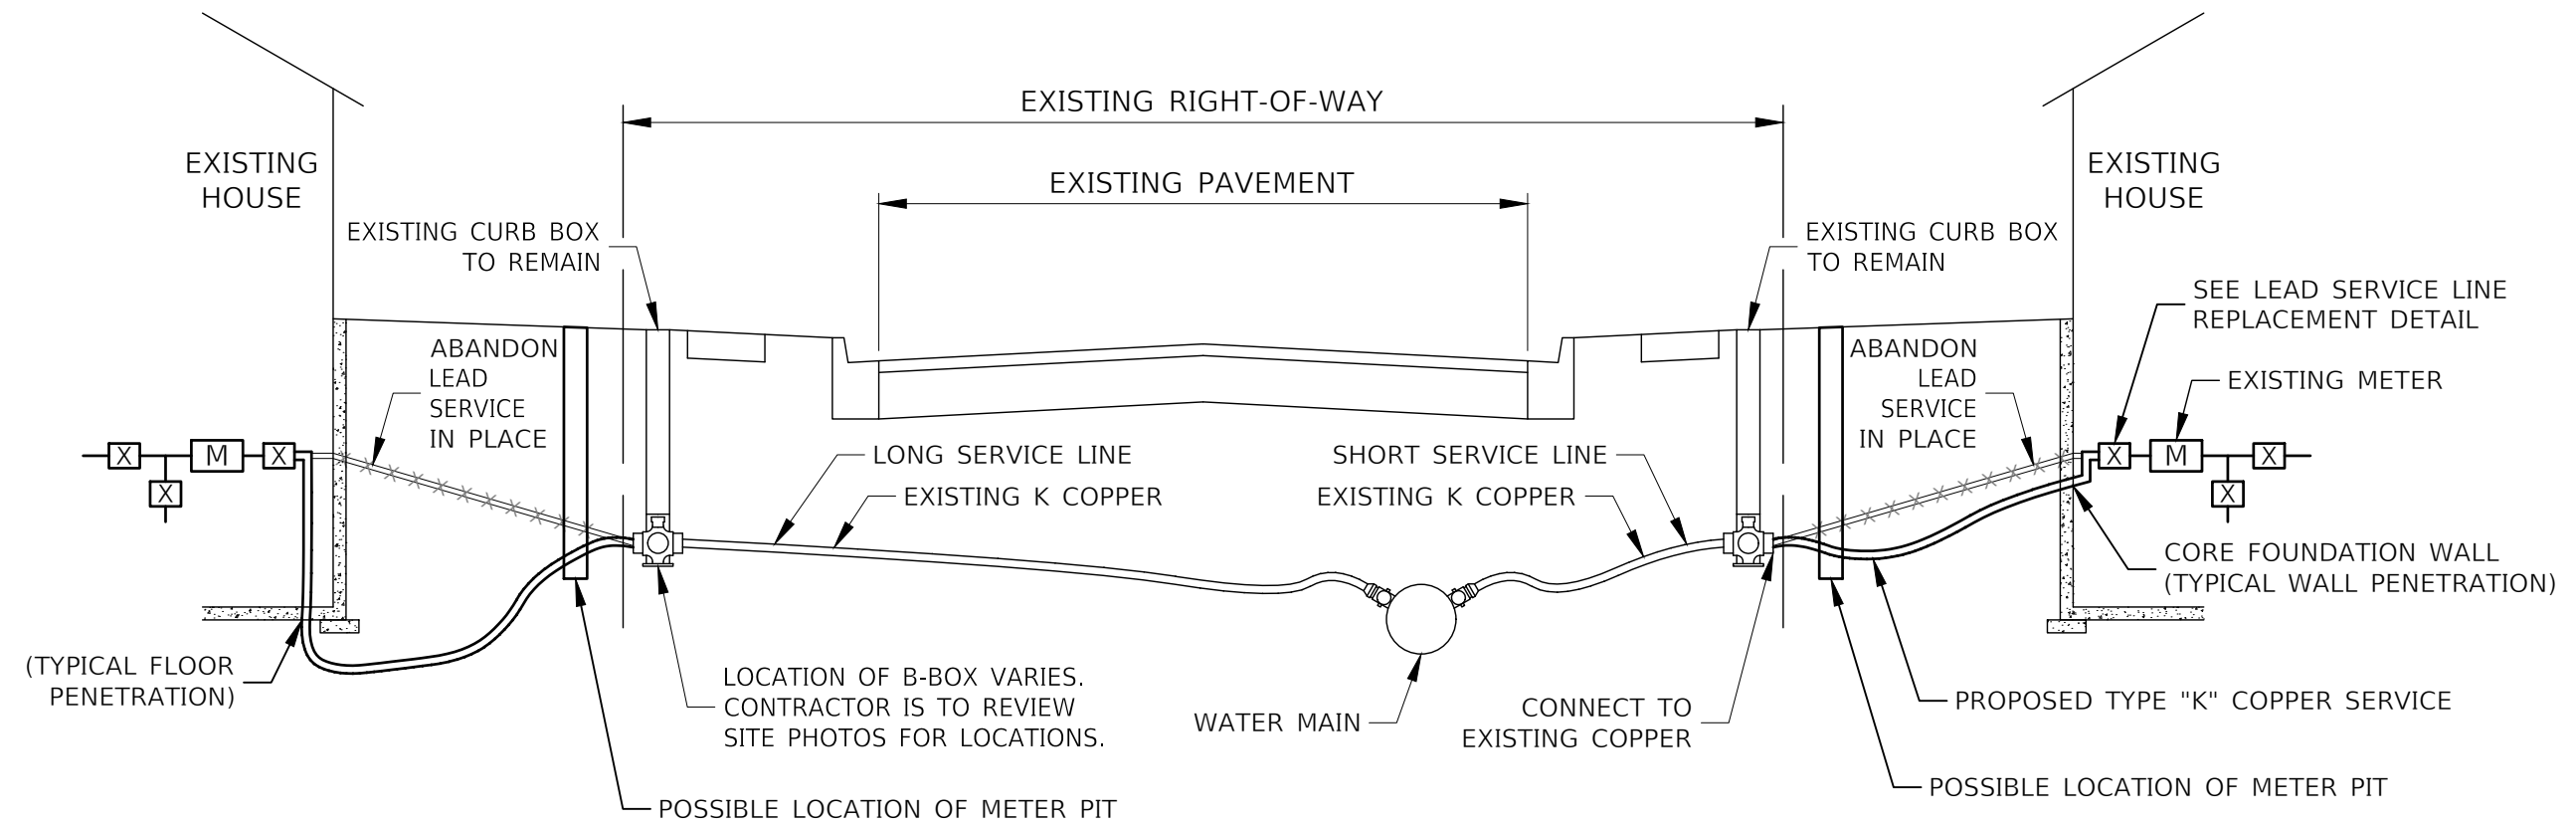


NOTE:

- ① ONLY CURB BOXES THAT ARE NOT FUNCTIONING ARE TO BE REPLACED PER THE SPECIAL PROVISIONS. ANY CURB BOXES THAT ARE BURIED SHALL BE ADJUSTED PER THE SPECIAL PROVISIONS.

PARTIAL LEAD WATER SERVICE REPLACEMENT
PRIVATE SIDE (COPPER)



22R0906_02-LSLR-DTLS-01

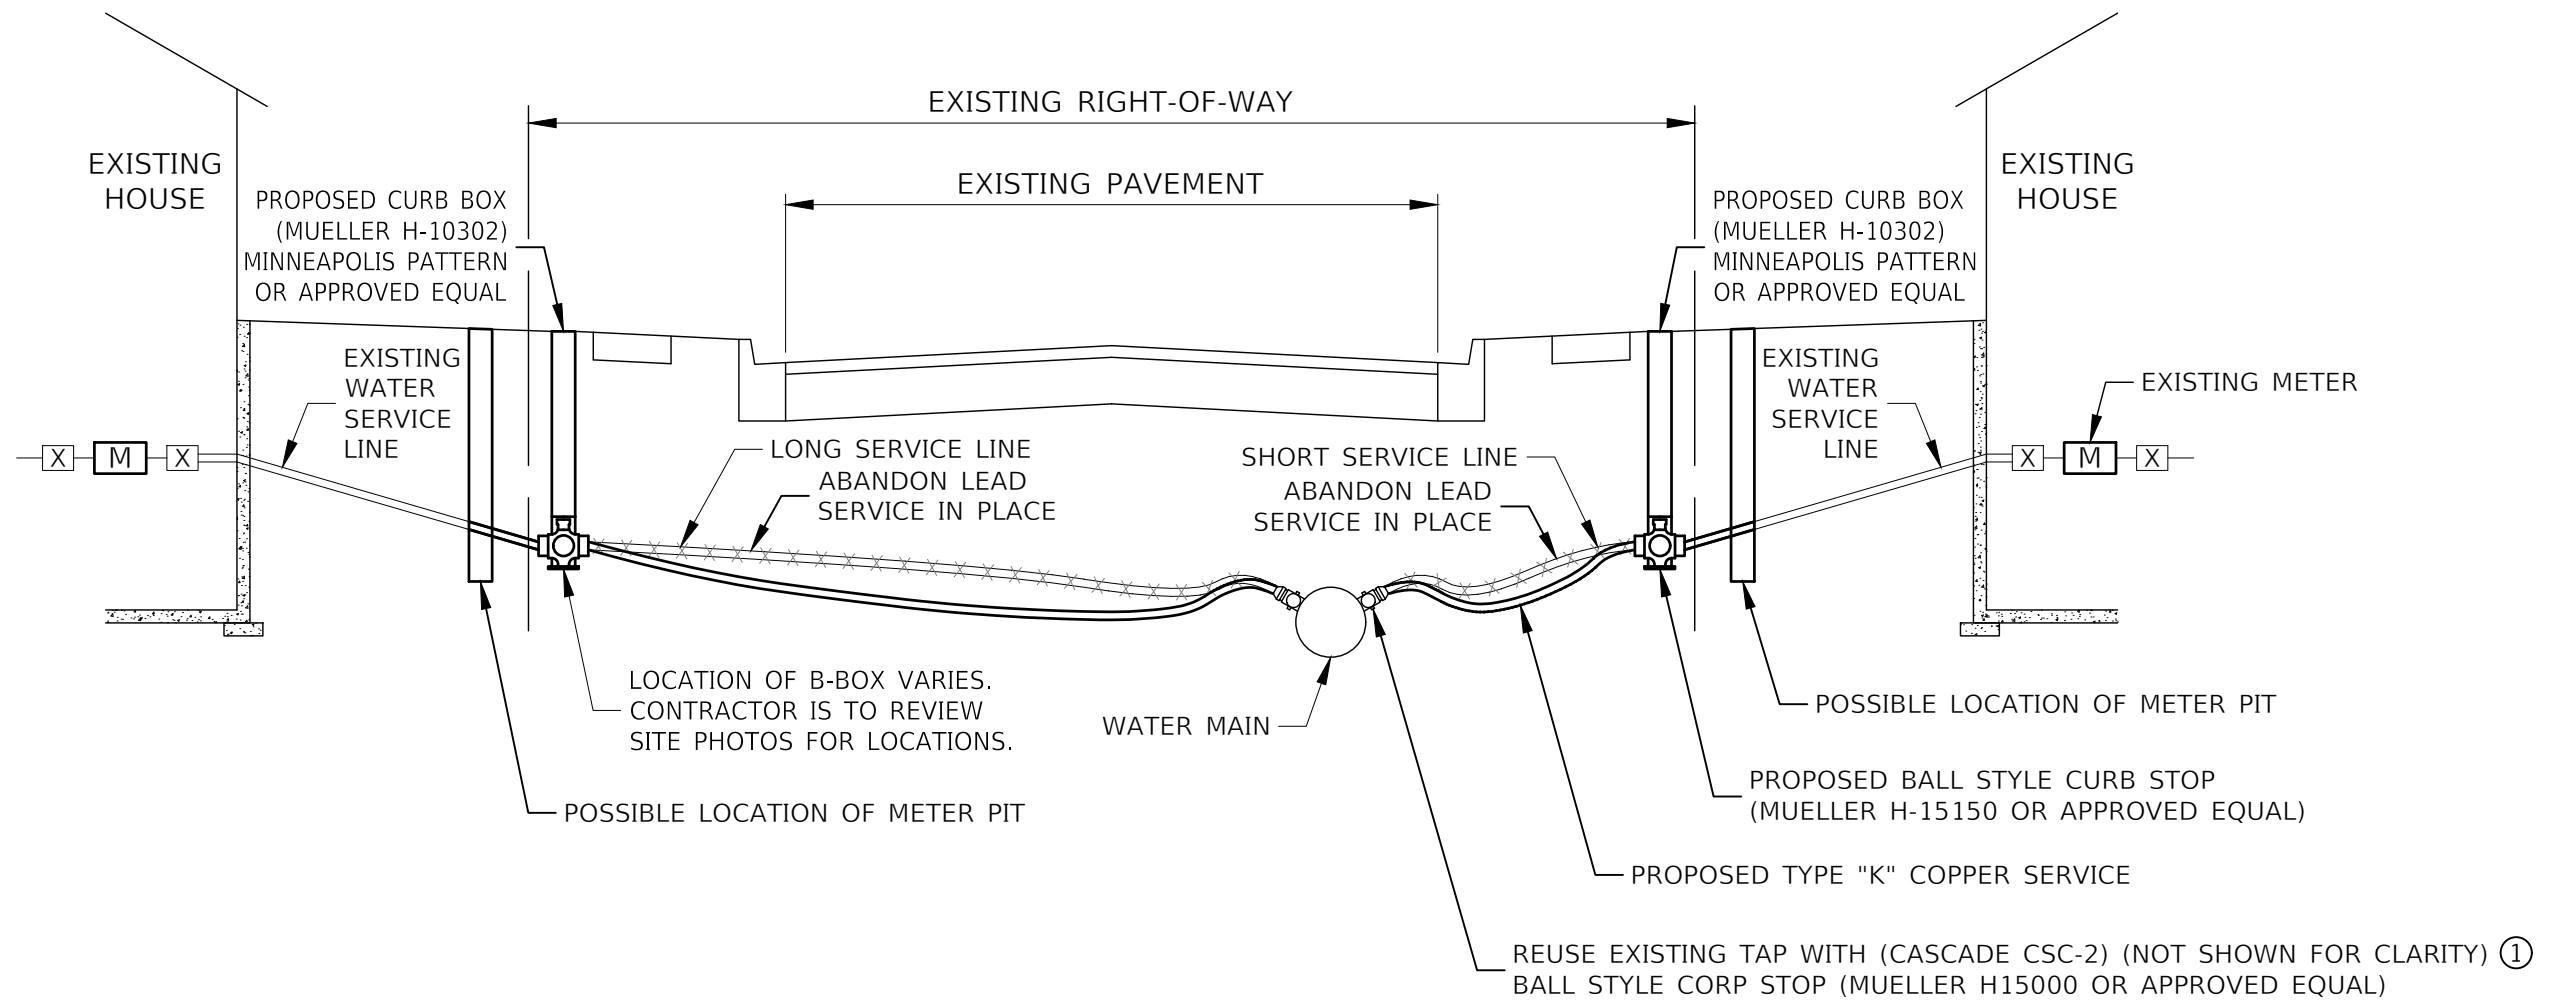

NOTE:
① SEE SPECIFICATIONS FOR WATER MAIN TAPPING.

PARTIAL LEAD WATER SERVICE REPLACEMENT
PUBLIC SIDE (COPPER)



22R0906_02-LSLR-DTLS-01

Appendix 6

Lead Service Line Replacement Outreach Materials

Bold (and foreign languages) must remain as-is. Normal font can be modified.

This notice contains important information about your water service and may affect your rights. We encourage you to have this notice translated in full into a language you understand and before you make any decisions that may be required under this notice.

Diese Mitteilung beinhaltet wichtige Informationen über Ihre Wasserversorgung und könnte Ihre Rechte beeinflussen. Wir bitten Sie, dass Sie diese Mitteilung vollständig in eine Sprache übersetzen lassen, die Sie verstehen, bevor Sie eventuelle Entscheidungen treffen, welche im Zusammenhang mit dieser Benachrichtigung erforderlich sind.

Ang abisong ito ay naglalaman ng mahalagang impormasyon tungkol sa iyong serbisyo sa tubig at maaaring makaapekto sa iyong mga karapatan. Hinihikayat namin kayo na isalin nang buo ang abisong ito sa wikang naiintindihan ninyo at bago kayo gumawa ng anumang mga desisyon na maaaring kailanganin sa abisong ito.

આ સૂચનામાં તમારી પાણીની સેવા વિશે મહત્વપૂર્ણ માહિતી શામેલ છે અને તમારા અધિકારોને અસર કરી શકે છે. અમે તમને પ્રોત્સાહિત કરીએ છીએ કે તમે આ સૂચના હેઠળ જરૂરી હોય તેવા કોઈપણ નિર્ણયો લો તે પહેલાં તમે આ સૂચનાને તમે સમજો છો તે ભાષામાં સંપૂર્ણ ભાષાંતર કરો.

Niniejsze zawiadomienie zawiera ważne informacje na temat Państwa przyłącza wodociągowego i może mieć wpływ na Państwa prawa. Przed podjęciem jakichkolwiek decyzji, które mogą być wymagane na mocy niniejszego zawiadomienia, zachęcamy Państwa do przetłumaczenia całości niniejszego zawiadomienia na język, który będzie dla Państwa zrozumiały.

يحتوي هذا الإشعار على معلومات مهمة حول خدمة المياه لديك، وقد يؤثر على حقوقك. قبل اتخاذ أي قرارات قد تكون مطلوبة بموجب هذا الإشعار فإننا نشجعك على ترجمته بالكامل إلى لغة تفهمها.

اس نوٹس میں آپ کی پانی کی سروسز سے متعلق اہم ترین معلومات موجود ہیں اور یہ آپ کے حقوق کو متاثر کر سکتا ہے۔ ہم آپ کو ترغیب دیں گے کہ آپ اس نوٹس کا مکمل طور پر اس زبان میں ترجمہ کروائیں جو آپ سمجھتے ہوں اور ممکن ہے کہ آپ کے کوئی فیصلہ لینے سے قبل اس نوٹس کے تحت یہ درکار بھی ہو۔

Este aviso contiene información importante sobre su servicio de agua y puede afectar sus derechos. Lo animamos a que traduzca este aviso a un idioma que comprenda antes de tomar cualquier decisión que pueda ser necesaria en virtud del mismo.

이 통지서에는 귀하의 권리에 영향을 미칠 수 있는 수도 서비스에 관한 중요한 정보가 제시되어 있습니다. 이 통지서에서 요구하는 결정을 내리기 전에 이 통지서를 귀하가 이해할 수 있는 언어로 번역하시기 바랍니다.

本通知包含有关您的供水服务的重要信息，可能会影响到您的权利。在您做出本通知所要求的任何决定之前，我们鼓励您将本通知完整地翻译成您可理解的语言。

IMPORTANT INFORMATION ABOUT LEAD IN YOUR DRINKING WATER

The Community Water System (CWS) has determined that your property is likely serviced by a lead water pipe. Lead can cause serious health problems, especially for pregnant women and children 6 years and younger. Please read this notice closely to see what you can do to reduce lead in your drinking water.

The CWS provides water that protects our residents from lead leaching into our water system. The CWS has not had a recent violation for lead levels. However, proper maintenance of the system to prevent the leaching of lead costs time, energy, and money. There is also the potential that something might go wrong and people with lead service lines would be exposed to lead in their drinking water.

Health Effects of Lead

It can cause damage to the brain and kidneys, and can interfere with the production of red blood cells that carry oxygen to all parts of your body. The greatest risk of lead exposure is to infants, young children, and pregnant women. Scientists have linked the effects of lead on the brain with lowered IQ in children. Adults with kidney problems and high blood pressure can be affected by low levels of lead more than healthy adults. Lead is stored in the bones and can be released later in life. During pregnancy, the child receives lead from the mother's bones, which may affect brain development.

Sources of Lead

The source of water from Lake Michigan does not contain lead. When water is in contact with service lines or plumbing that contains lead for several hours, the lead may enter drinking water. Homes built before the 1960s in our community are more likely to have lead service lines and lead in solder and plumbing fixtures.

Don't forget, most lead exposure is still from small children ingesting lead paint, dust, and soil. In addition, lead can be found in certain types of pottery, pewter, brass fixtures, food, and cosmetics. Other sources include exposure in the work place and exposure from certain hobbies (lead can be carried on clothing or shoes). Lead is found in some toys, some playground equipment, and some children's metal jewelry. Wash your children's hands and toys often as they can come into contact with dirt and dust containing lead.

Steps That You Can Take to Reduce Your Exposure to Lead in Your Drinking Water

1. *Run your water to flush out lead.*
 - a. If the plumbing in your home is accessible; you may be able to inspect your own plumbing to

- determine whether you have a lead service line. Otherwise, you will most likely have to hire a plumber, or allow the Village to inspect your water line.
- b. If you do not have a lead service line, running the water for 1 - 2 minutes at the kitchen tap should clear the lead from your household plumbing to the kitchen tap. Once you have done this, fill a container with water and store it in the refrigerator for drinking, cooking, and preparing baby formula throughout the day.
 - c. If you do have a lead service line, flushing times can vary based on the length of your lead service line and the plumbing configuration in your home. The length of lead service lines varies considerably.
 - d. The following flushing guidelines are recommended by the American Water Works Association after a lead service line is replaced:
 - i. Find all the faucets that will drain, including the basement and all floors in your house.
 - ii. Remove aerators and screens whenever possible, including the shower heads, from all faucets you plan to flush.
 - iii. Include the laundry tubs, hose-bibs, bathtubs, and showers as flushing points.
 - iv. After all the aerators are off, open the faucets in the basement or lowest floor in the house. Leave all faucets running at highest rate possible, using cold water.
 - v. After the faucets are all open in lowest floor, open the faucets on next highest floor of the house. Continue until faucets are open on all floors.
 - vi. After all faucets are opened, leave the water running for at least 30 minutes.
 - vii. After 30 minutes, turn off the first faucet you opened and continue to turn off other faucets in the same order you turned them on.
 - viii. Clean aerators/screens at each faucet. You may need to replace screens/aerators if too old or worn
2. *Use cold water for drinking, cooking, and preparing baby formula.*
 - a. Do not cook with or drink water from the hot water tap; lead dissolves more easily into hot water.
 - b. Do not use water from the hot water tap to make baby formula.
 3. *Look for alternative sources or treatment of water.*
 - a. You may want to consider purchasing bottled water; or
 - b. Purchase a water filter that is certified to remove "total lead". The filter should be NSF 53 and NSF 42 certified.
 4. *Clean and remove any debris from faucet aerators on a regular basis.*
 5. *Do not boil water to remove lead.* Boiling water will not reduce lead.
 6. *Purchase lead free faucets and plumbing components.*
 7. *Remove the entire lead service line.*
 - a. *As part of the separate Lead Service Line Replacement program, should you agree to participate, the Village will replace your lead service line from the water main to the meter inside your home.*
 8. *Test your water for lead.*
 - a. Call us at: 815-412-2015 to find out how to get your water tested for lead. While we do not do the testing, we can provide a list of laboratories certified to do the testing. Laboratories will send you the bottles for sample collection. Please note that we are not affiliated with the laboratories, and they will charge you a fee.
 - If test results indicate a lead level above 15 ug/L, bottled water should be used by pregnant women, breast-feeding women, young children, and formula-fed infants.
 - b. Approximately one month after service line replacement, testing is recommended. The sample should be a first-draw sample after water has not been used for at least 6 hours. The sample must be collected from a tap used frequently inside the home, preferably from the kitchen.
 - c. As a precaution, until the sample is collected and analyzed, the customer is recommended to do a mini-flush of premise plumbing by running tap water each morning or when the water sits in the pipe for at least 6 hours. Flush for 5 minutes to displace water that has been sitting in the pipes inside the house and in the service line. This could include taking a shower, running the dishwasher, flushing a toilet, collecting water for plants/garden, or running the faucet. The customer should do this before using any

water for drinking, cooking, infant formula, and so on. Daily miniflushes should continue for six months or until lead sample results show the lead level is below the regulatory guideline. The customer should clean debris from aerators and screens once a month for six months. After six months, clean debris twice a year.

For More Information

Call us at () or visit our website at (). For more information on reducing lead exposure around your home/building and the health effects of lead, visit EPA's website at www.epa.gov/lead or contact your health care provider.

Thank you for reading this notice, and we hope to hear from you soon.

Salutation

